


Date: **Monday 13 Apr 2020**


BSUoS Charge Estimate: £7.59/MWh
Total Outturn: £7.25m

■ BM Cost (Indicative)




■ AS Cost (Estimate)



Daily Balancing Costs



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

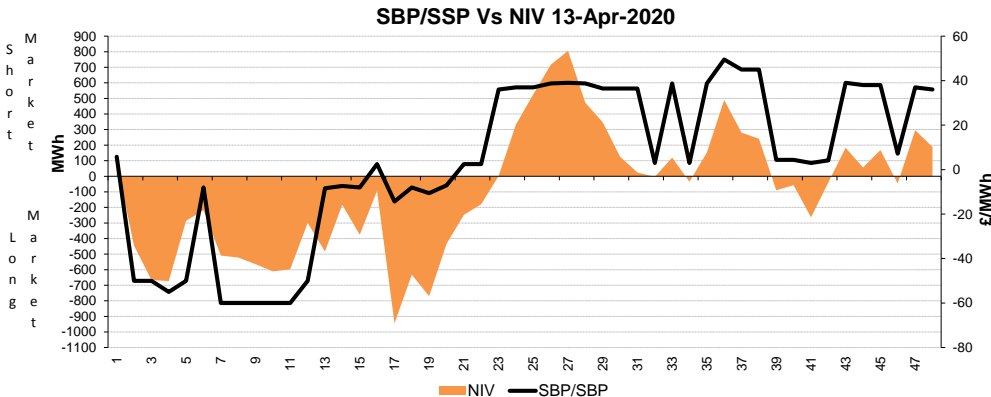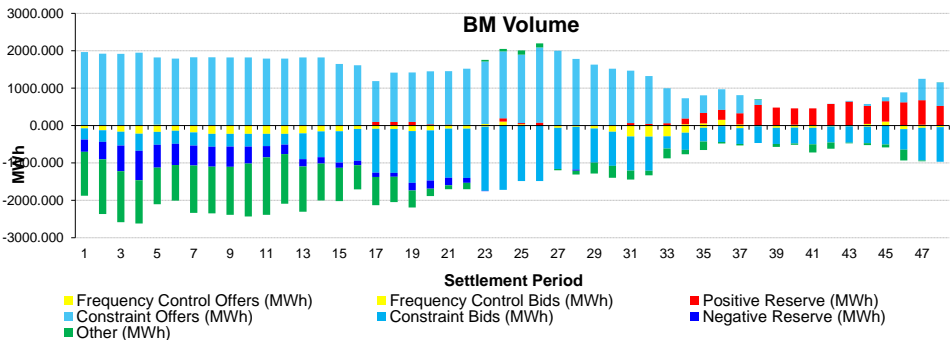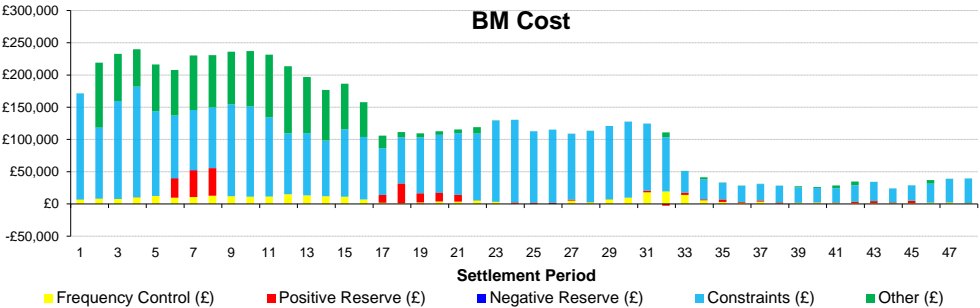

Commentary

The market started off long but change to a mostly short position just before midday. Trades were carried out for margin.

Trades were required to manage RoCoF risk through the day and overnight. BM Action were needed for voltage control.

Western Link status: Available