


Date: Wednesday 15 Apr 2020

BSUoS Charge Estimate: £2.97/MWh

Total Outturn: £2.89m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

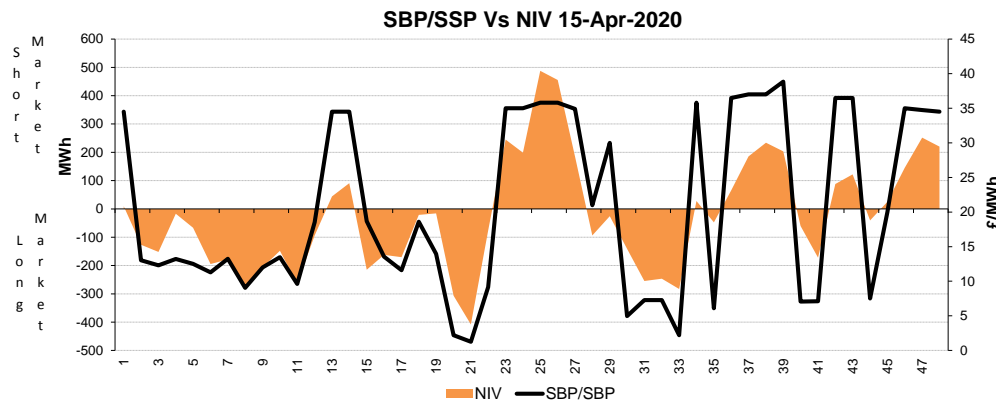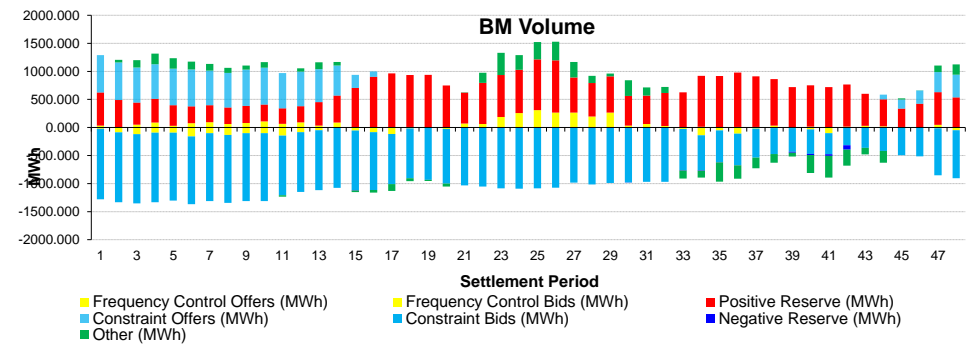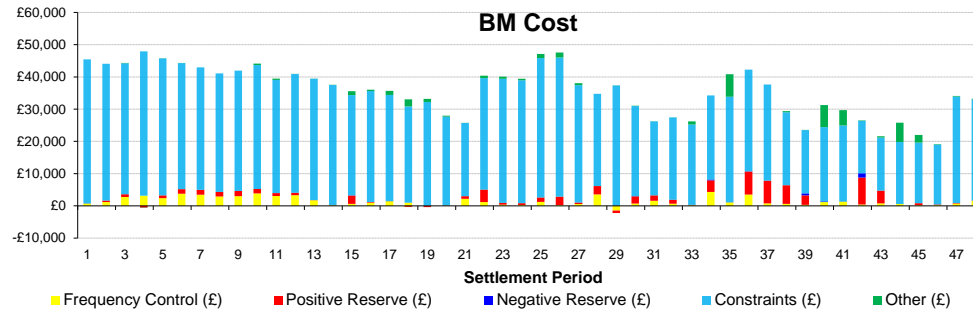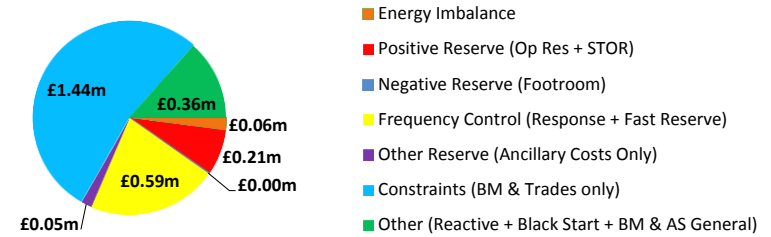

Western Link status: Available

Commentary

The market was mostly long until 11am. It then varied between long and short for the rest of the day. There were low levels of wind but high levels of solar.

BM Actions were required to reduce thermal constraints in Scotland. The RoCoF trigger level was raised due to low wind and high PV.