

Date:


Wednesday 27 Apr 2022

BSUoS Charge Estimate: £2.06/MWh

Total Outturn: £1.93m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

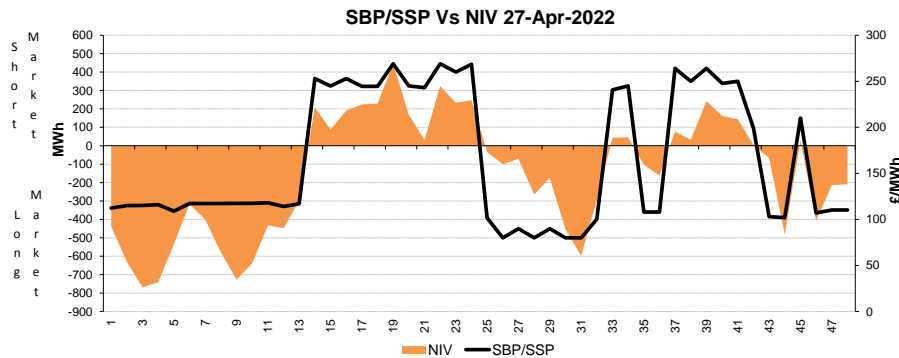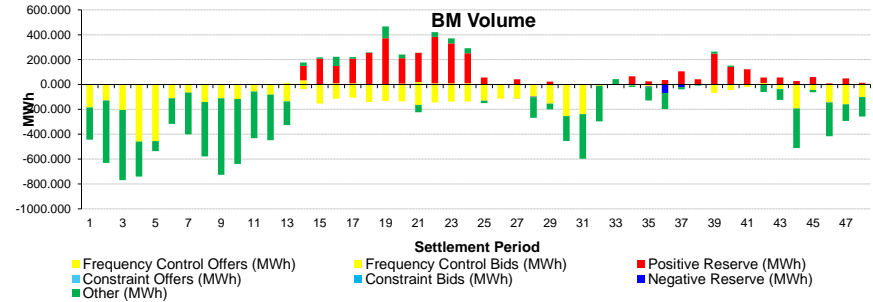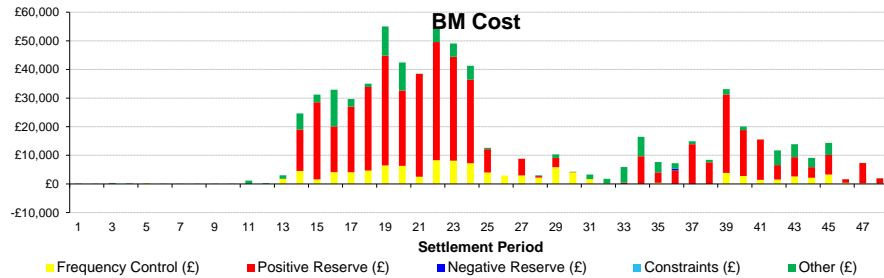

Commentary

A long market overnight to the early morning, becoming short over the morning to midday, and over the early evening period. 84MW of STOR was run over the evening.
All Voltage requirements met by the market, and no active constraints.