


Date: Sunday 17 Apr 2022

BSUoS Charge Estimate: £5.19/MWh

Total Outturn: £4.26m





BM Cost (Indicative)

AS Cost (Estimate)



## Daily Balancing Costs

nationalgridESO

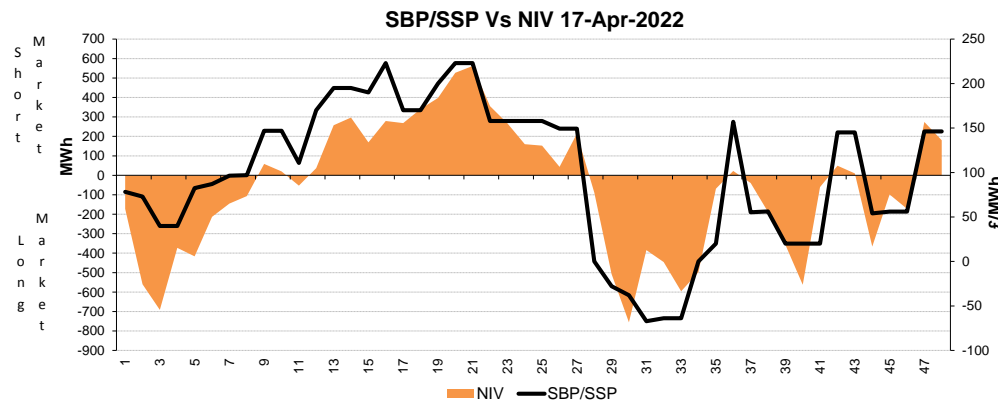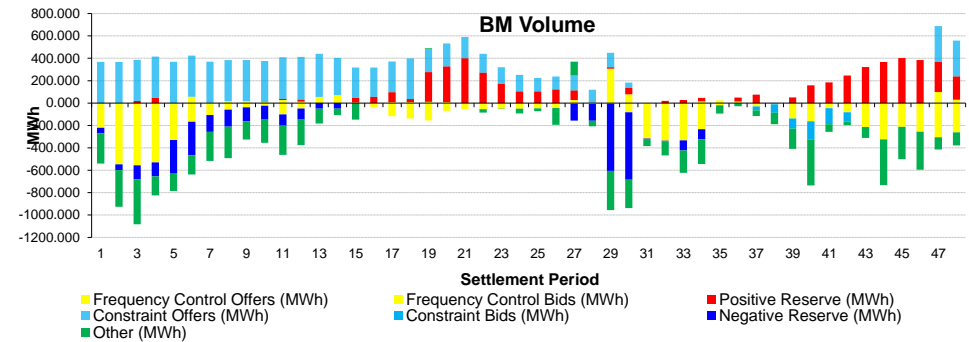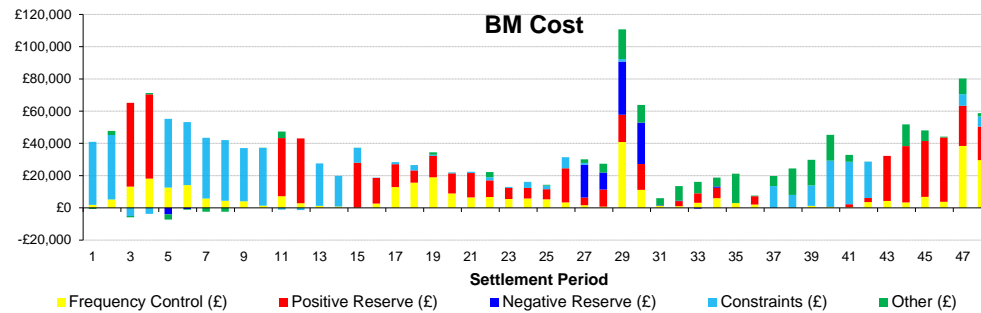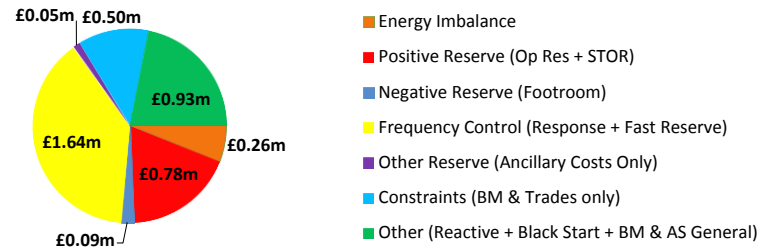

### Commentary

The market was short from the early hours of the morning until the early afternoon. Interconnector Trades were required for Downward Regulation overnight to the early morning, and during the afternoon period. Trades and BM Action supported overnight Voltage Control in the Midlands, South East of England, and North West of England. Some BM Action required briefly around 8am in the morning for System Inertia. BM Action alleviated thermal export constraints in Scotland during the early evening.