



Date: Thursday 20 May 2021

BSUoS Charge Estimate: £4.27/MWh  
Total Outturn: £5.41m




BM Cost (Indicative)  
AS Cost (Estimate)



# Daily Balancing Costs

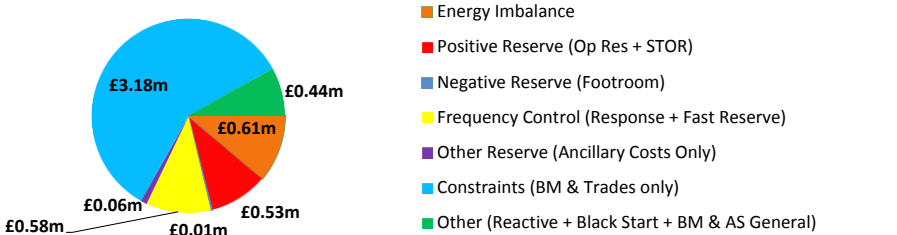

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

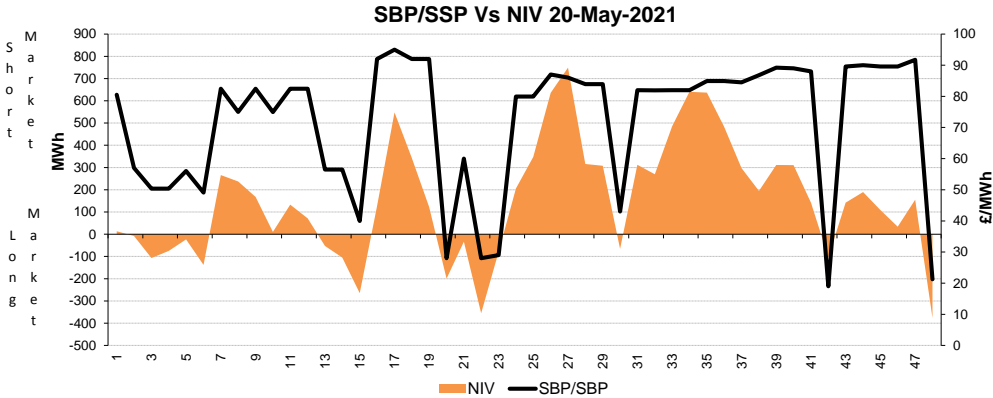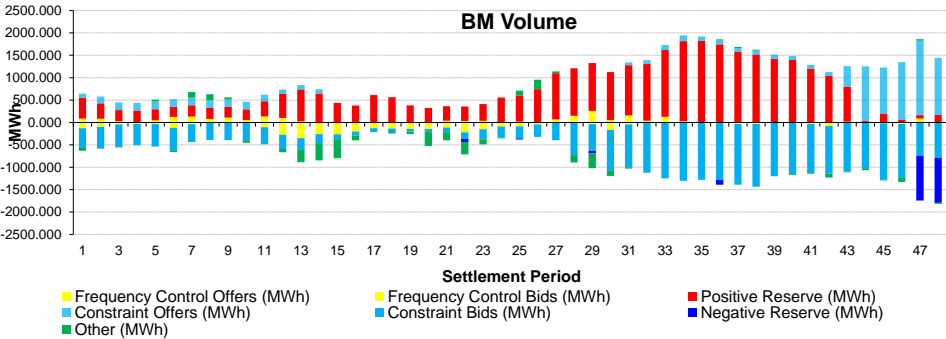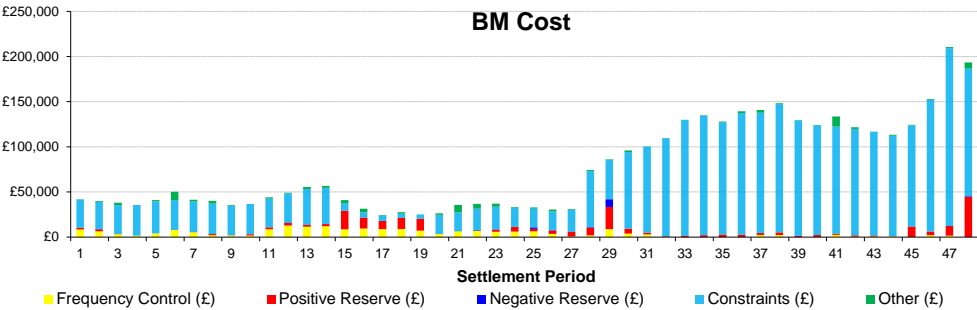

Western Link status: Available

## Commentary

A mostly short market throughout the day. Interconnector Trades required for Downward Regulation from 11pm in the evening.  
Overnight Trades and BM Action supported Voltage Control. Trades and BM Action throughout the day for RoCoF.  
BM Action alleviated thermal export constraints in the North from early afternoon onwards into the night.