


Date: Tuesday 03 May 2022

BSUoS Charge Estimate: £4.21/MWh

Total Outturn: £4.74m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

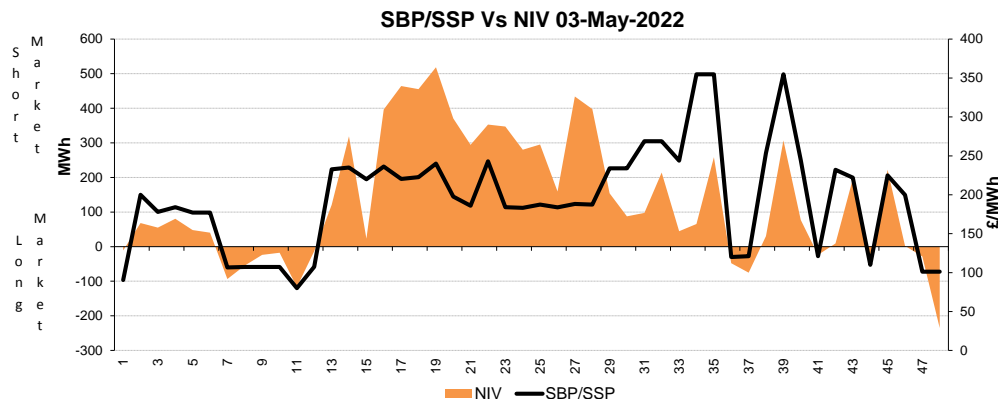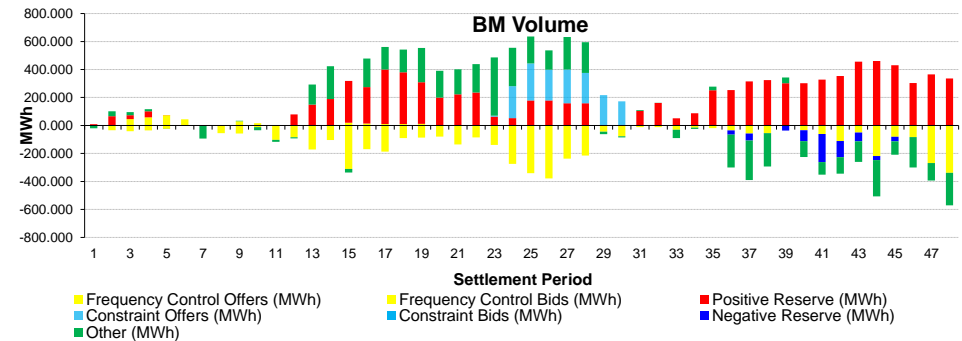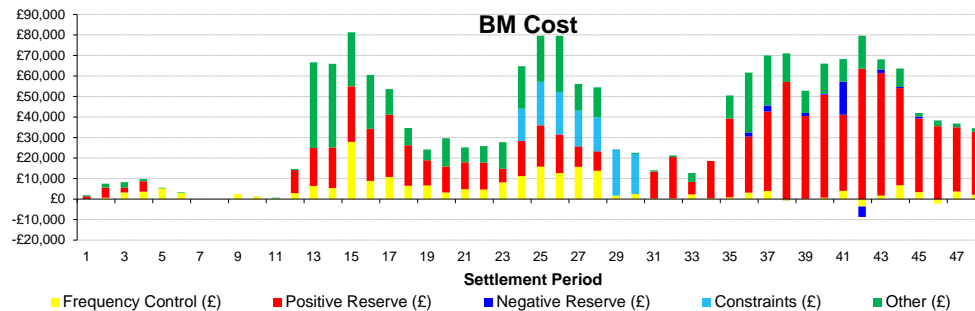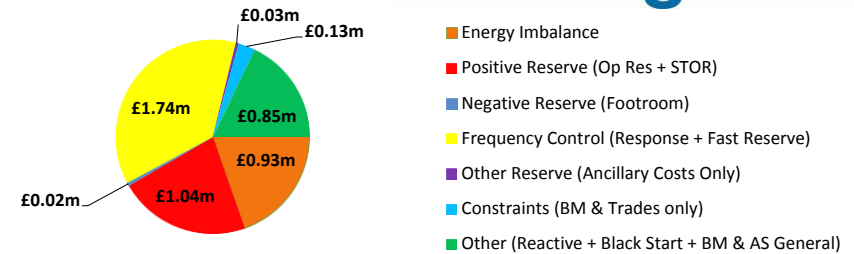

Commentary

A predominantly short market throughout the day. Interconnector Trades were required for Margin from 6am in the morning onwards.
All Voltage requirements met by the market and no BM Action required for System Inertia. BM Action managed thermal import constraints in Scotland around midday to the early afternoon.