
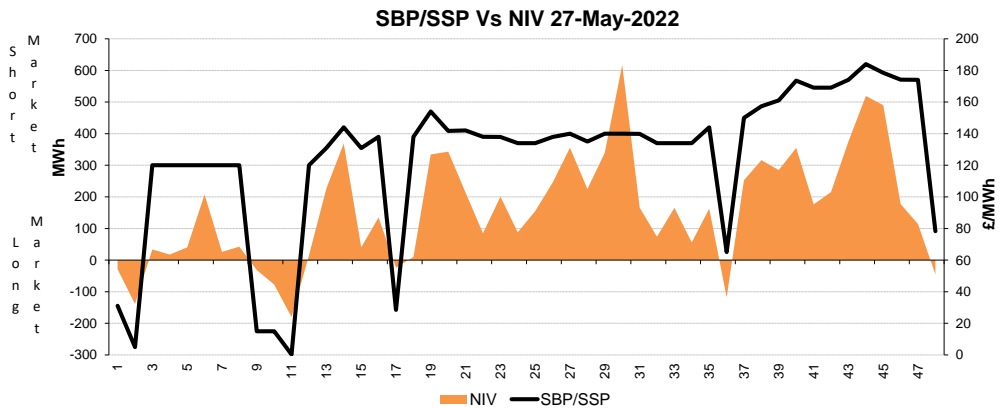
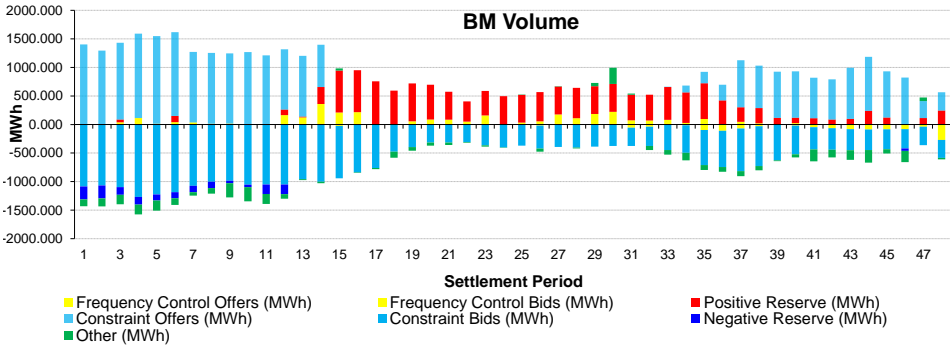
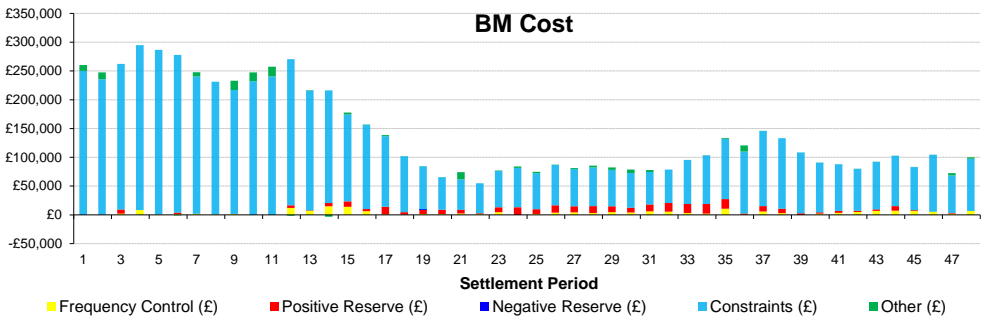
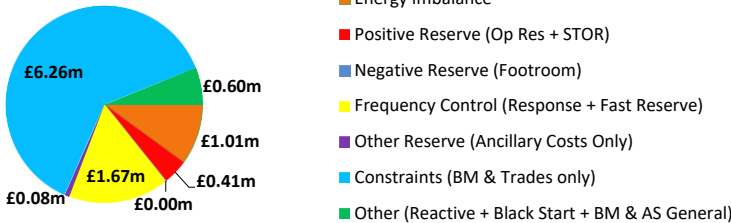


Date: Friday 27 May 2022

BSUoS Charge Estimate: £10.78/MWh
Total Outturn: £10.34m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

The market was short in excess of 1000MW between the morning pick up and the late evening. Overnight, multiple trades on the interconnectors were undertaken for downward regulation. Large volume of BM actions were undertaken to solve power flow restrictions in Scotland and on the network boundary between England and Scotland. From the evening, multiple trades on the interconnectors were required to solve import constraints in the south regions. Overnight offers were accepted in the BM to manage the voltage levels in England and to mitigate the RoCoF risk.