


Date: Wednesday 04 May 2022

BSUoS Charge Estimate: £3.95/MWh

Total Outturn: £4.24m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

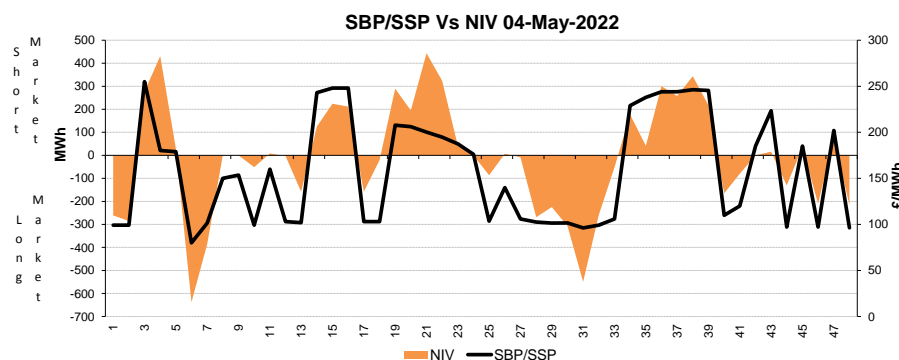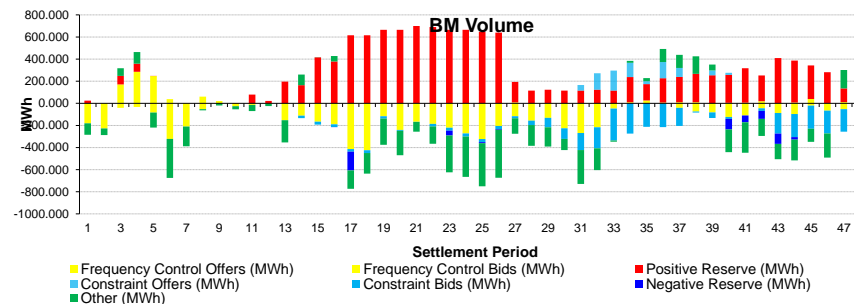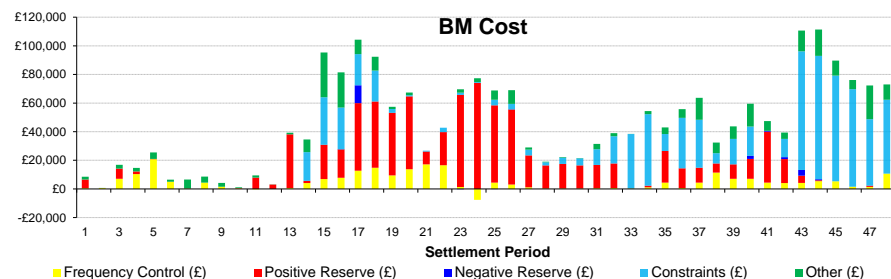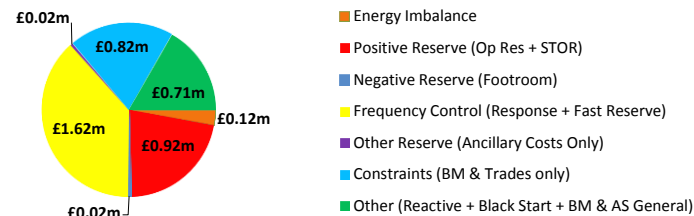

Commentary

The market was short over the morning from 7am to midday, and during the late afternoon to early evening period. Interconnector Trades were required for Margin during this same morning period, and also from the early evening onwards into the night.

All Voltage requirements met by the market and no action required for System Inertia. BM Action managed thermal import constraints in the South East of England during the late afternoon, and thermal export constraints in Scotland in the evening to night. BM Action alleviated localised thermal export constraints in the North of Scotland all day.