


Date: Thursday 02 Jun 2022

BSUoS Charge Estimate: £4.64/MWh

Total Outturn: £3.91m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO

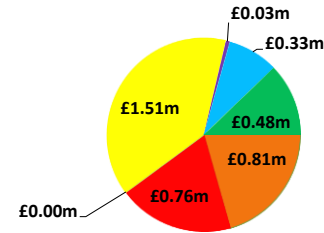

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

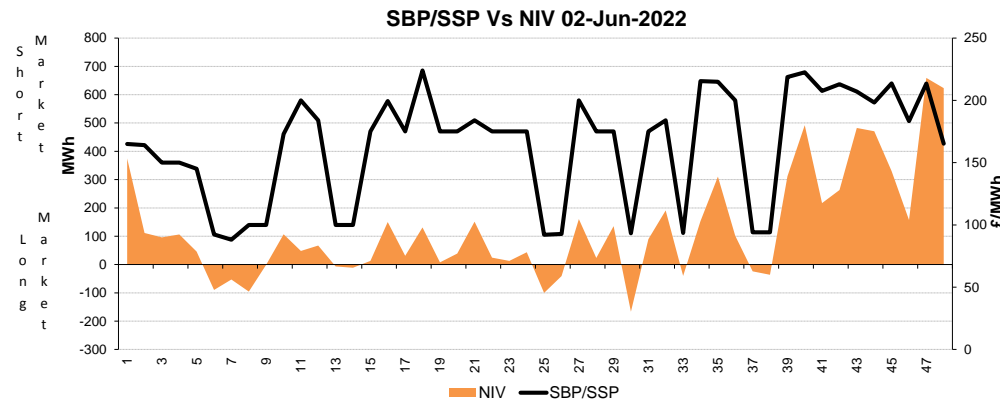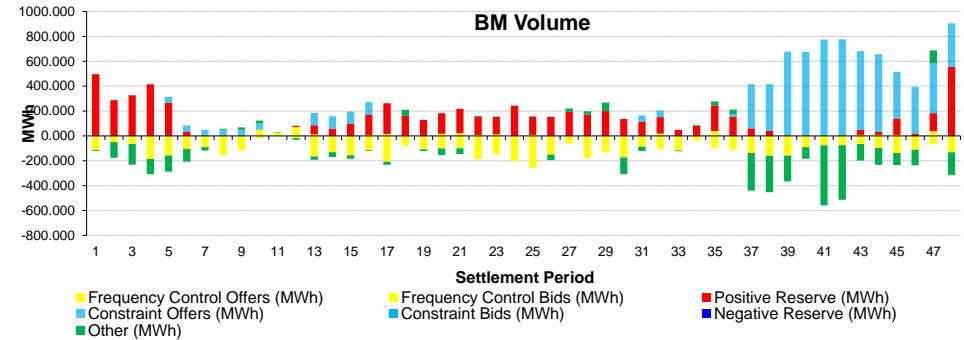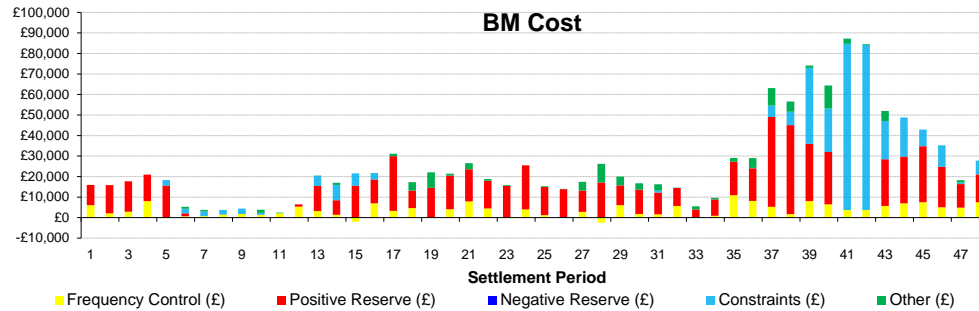

Commentary

A short market throughout the day.

Trades were required for thermal import constraints in the South East of England during the early morning and from mid afternoon onwards alongside BM Action to alleviate. All overnight voltage requirements met by the market.