






Date: Monday 06 Jun 2022

BSUoS Charge Estimate: £4.13/MWh
Total Outturn: £4.31m

BM Cost (Indicative)
AS Cost (Estimate)



Daily Balancing Costs

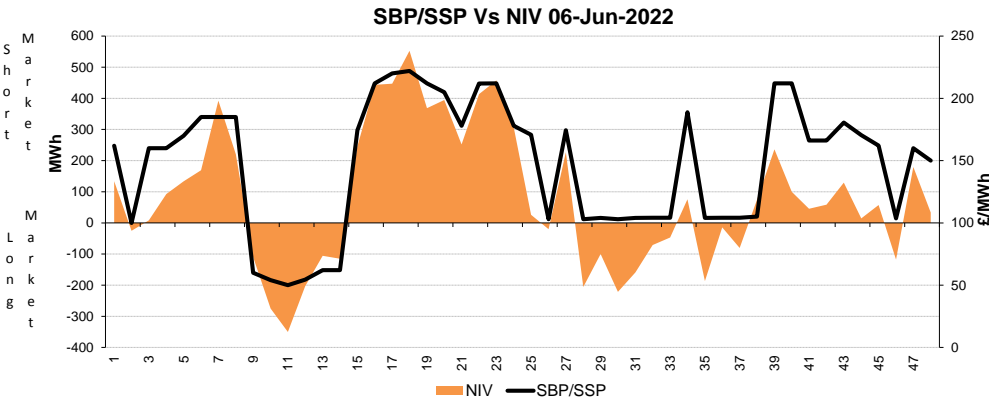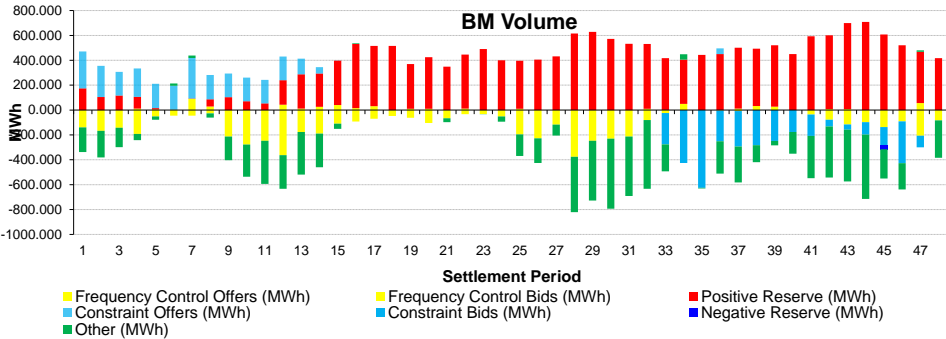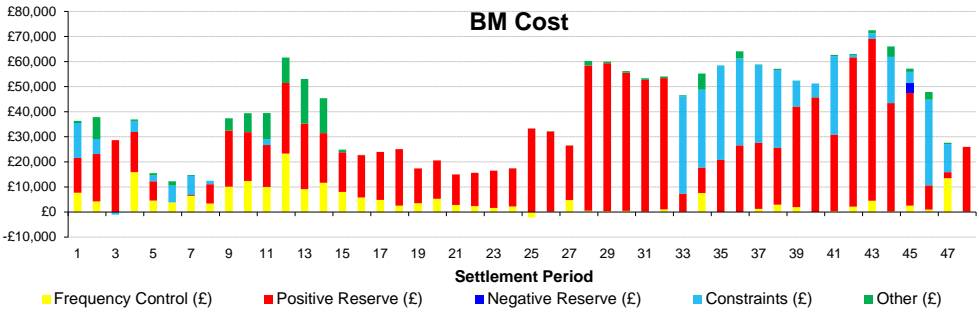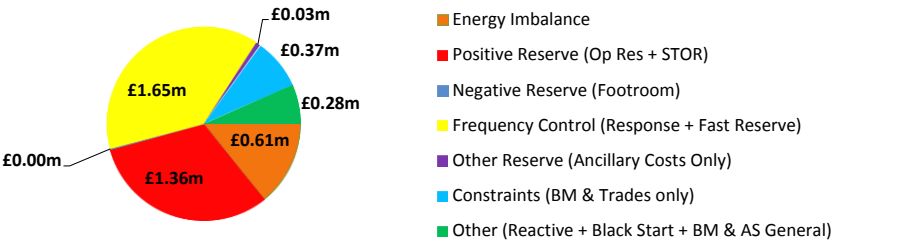

Commentary

The market was short overnight to the early hours at the start of the day, during the morning to midday, and from the early evening into the night. Interconnector Trades were required for Margin in the evening. 175MW of Non-BM Fast Reserve was run during the morning period. Overnight Voltage Control supported by BM Action in the South East of England and the Midlands. BM Action alleviated thermal export constraints in the East of England from late afternoon into the evening.