
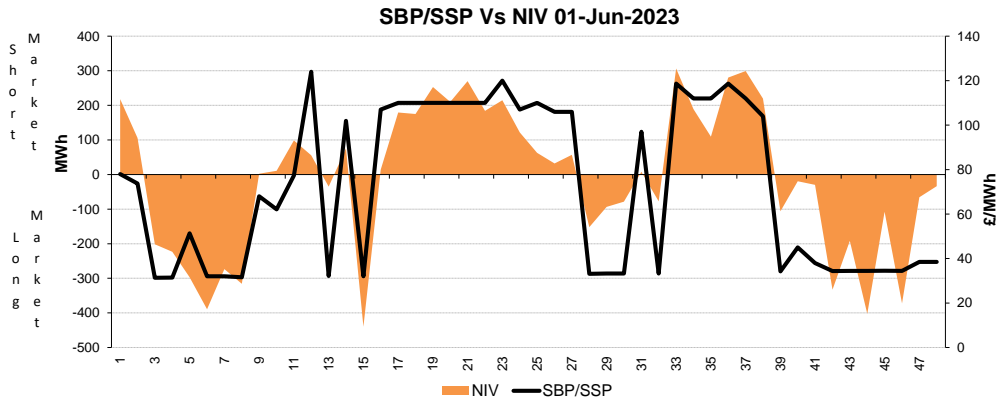
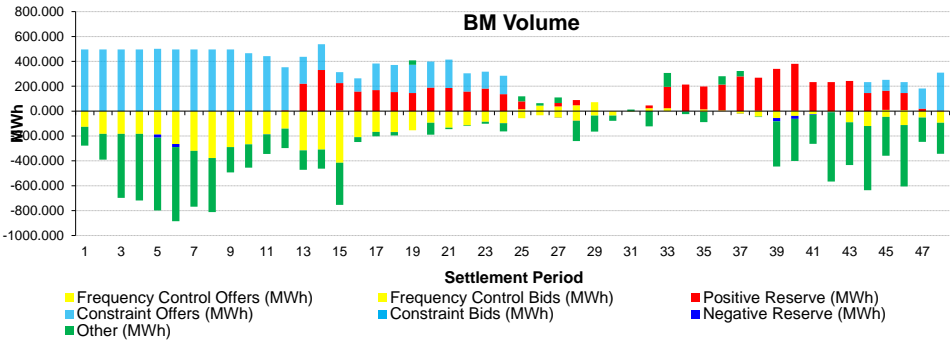
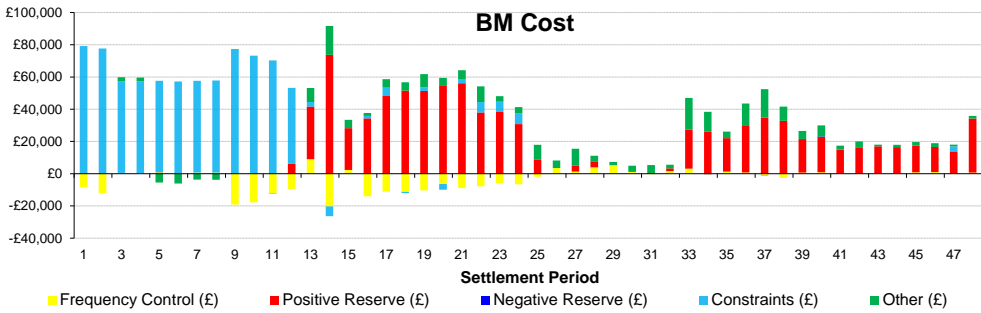
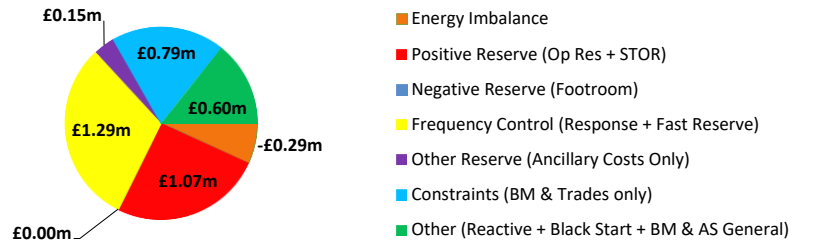


BM Cost (Indicative)

AS Cost (Estimate)



**Commentary**

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation.

No constraints were active. Trades and BM Actions were required to support Voltage Control.