

Date: Tuesday 06 Jul 2021

BSUoS Charge Estimate: £4.52/MWh






Total Outturn: £4.70m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

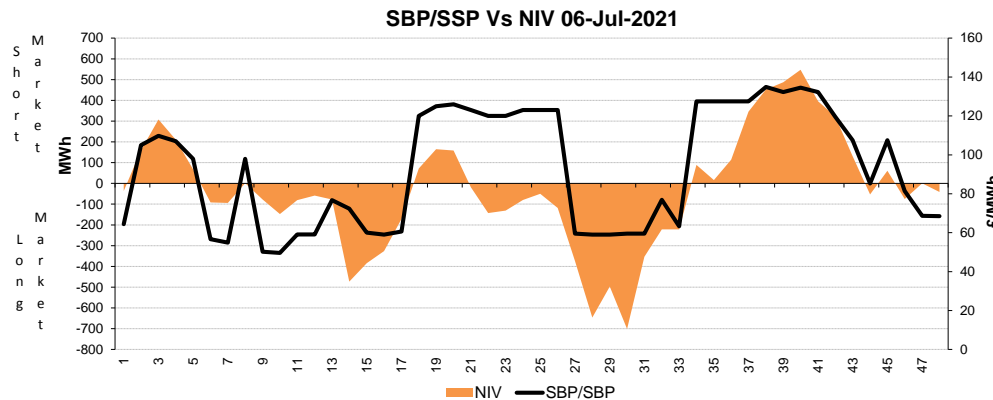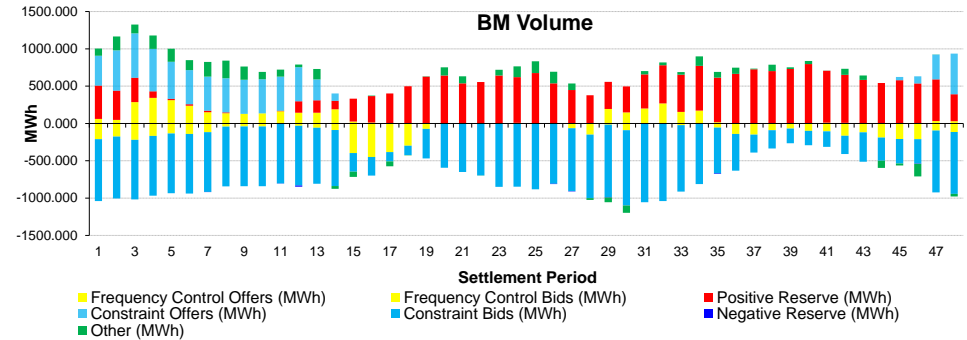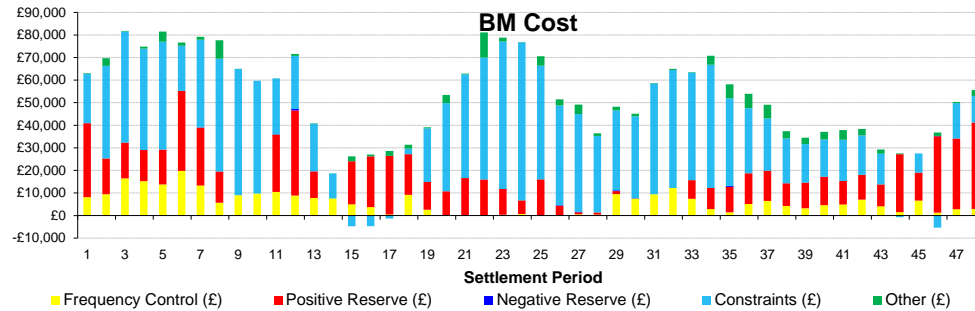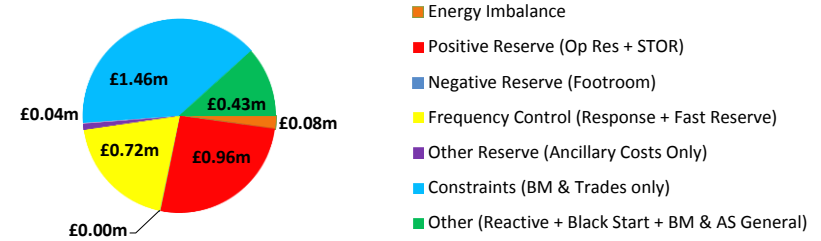

Western Link status: Unavailable

Commentary

The market was short between the early morning to just after midday, and from late afternoon into the late night. Trades were required to alleviate thermal export constraints in the South East of England from 10am to 1pm, and along the South Coast of England from 1pm to 6pm. Additional BM Action helped managed these South Coast thermal export constraints from morning to late evening. Overnight Voltage Control supported by Trades and BM Action. Interconnector Trades throughout the day for RoCoF. BM Action during the day assisted with System Inertia.