


Date: Saturday 02 Jul 2022

BSUoS Charge Estimate: £3.46/MWh

Total Outturn: £2.56m





BM Cost (Indicative)

AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

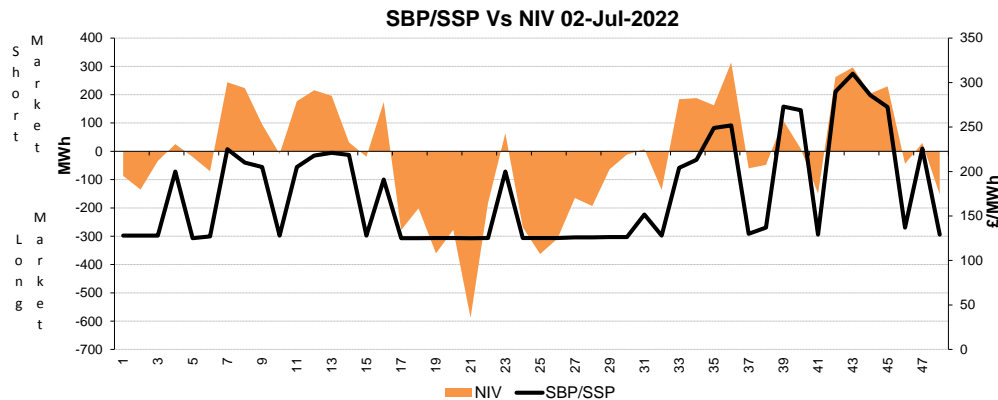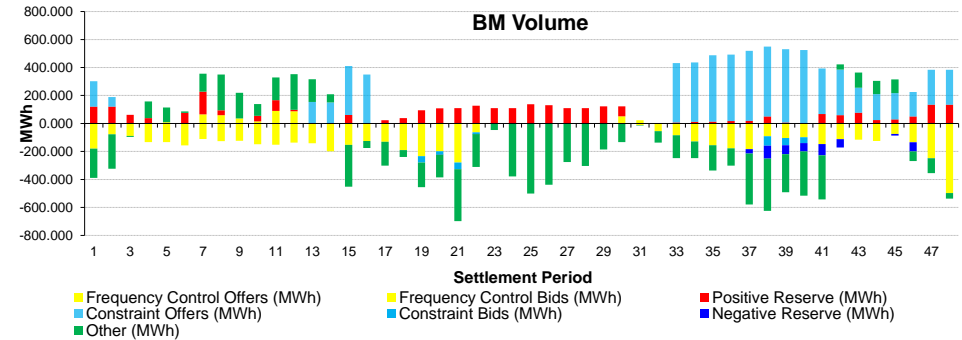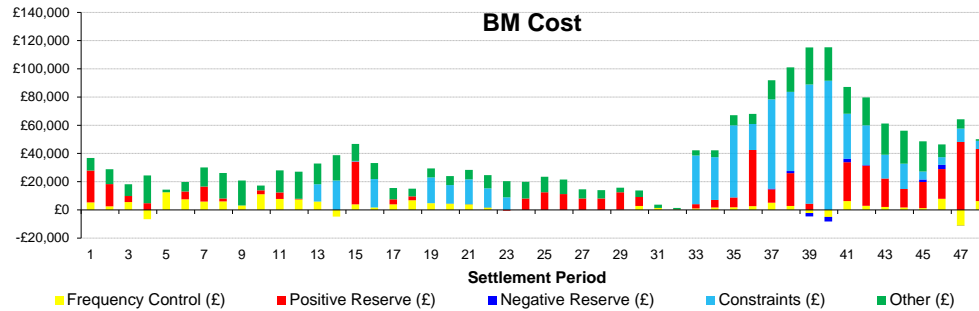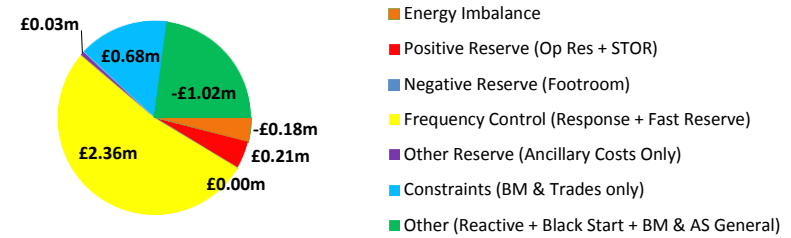

Commentary

A short market in the early hours of the day and from the late afternoon to evening period. Interconnector Trades were required for Response throughout the day. Trades managed power flow constraints from the North to South of England during the morning and from the early evening onwards, with BM Action additionally in the evening. Trades also alleviated thermal import constraints in the South East of England during the afternoon. BM Action was required for thermal export constraints in the East of England during the late morning. All overnight Voltage requirements met by the market.