
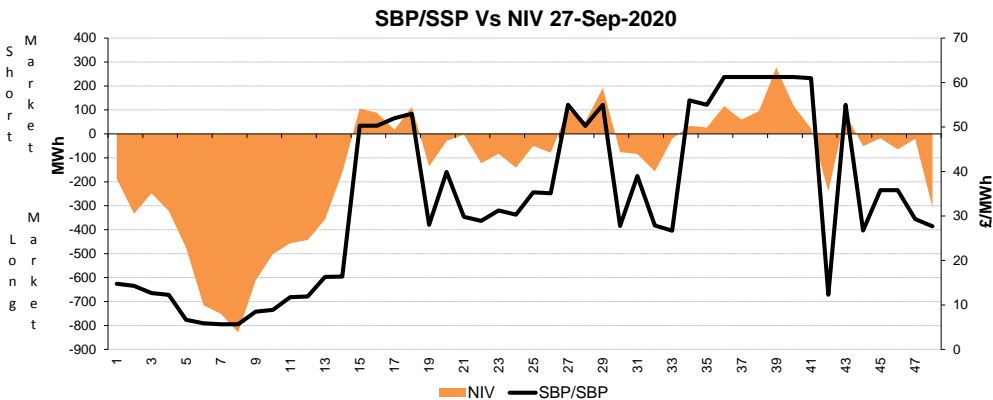
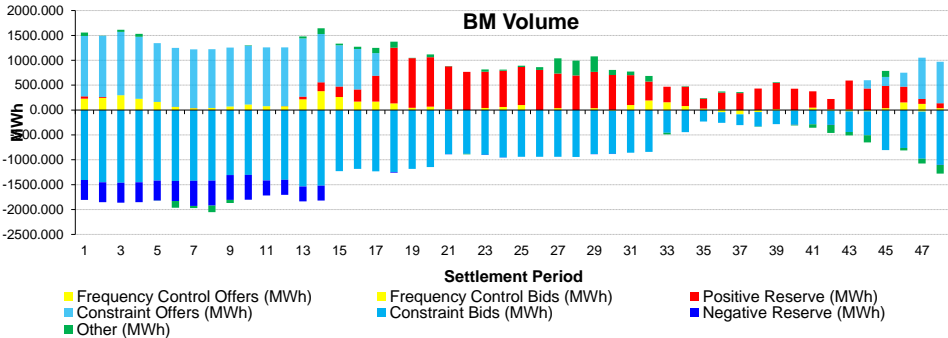
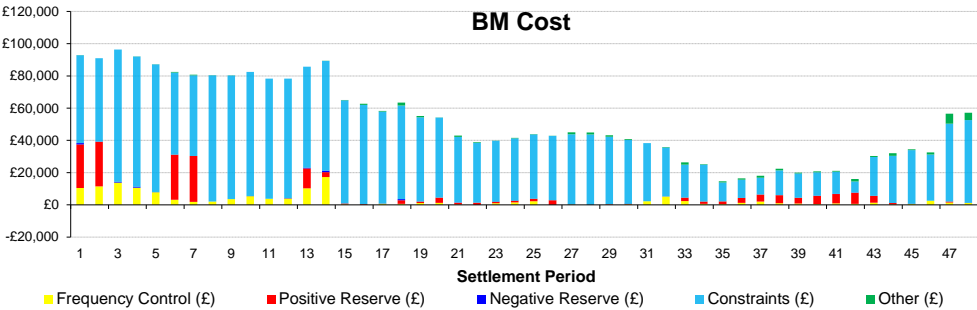
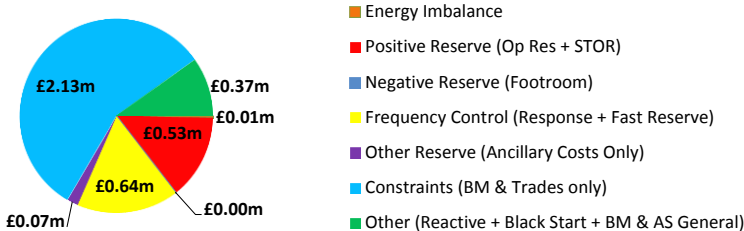


Date: Sunday 27 Sep 2020

BSUoS Charge Estimate: £3.45/MWh  
Total Outturn: £3.76m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)



Western Link status: Available

## Commentary

The market peaked long overnight and into the morning, alternating short and long intermittently from 7am onwards. Overnight Voltage Control supported by Trades and BM Actions. Trades and BM Actions throughout the day for RoCoF. BM Action required to alleviate thermal export constraints in the Wales area from morning onwards, and briefly in the East during the early morning and late afternoon.