

Date: Monday 26 Sep 2022

BSUoS Charge Estimate: £14.87/MWh






Total Outturn: £16.45m

# Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

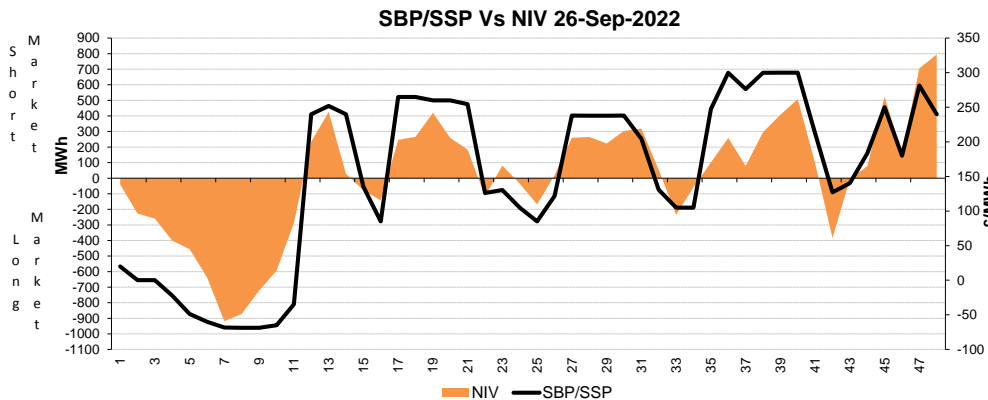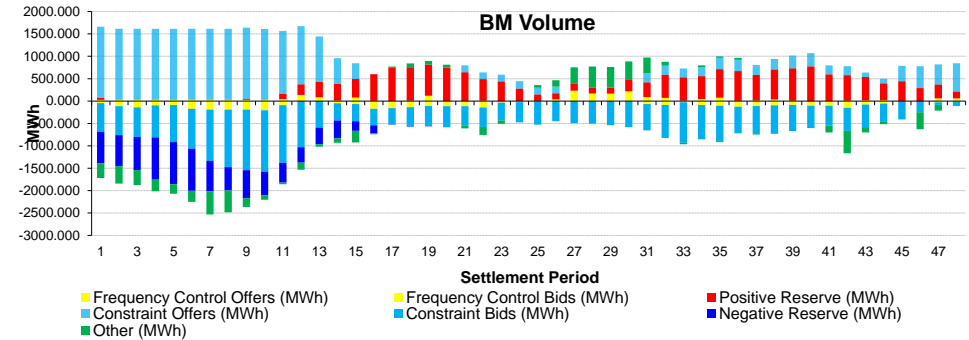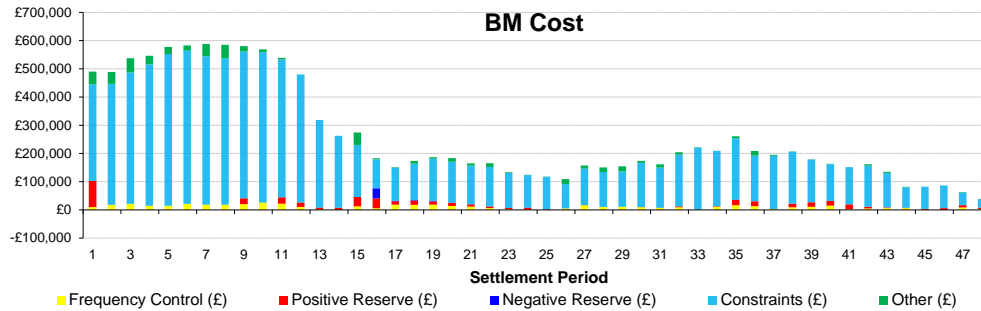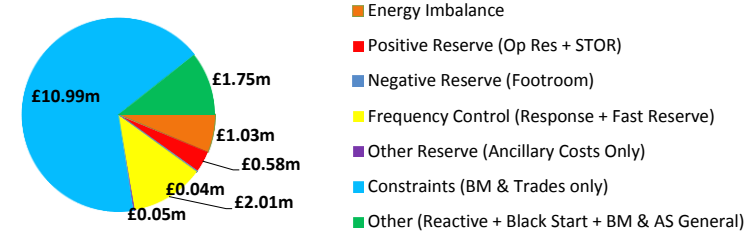

## Commentary

The market was long until 6am and mostly short for the rest of the day. Trades were made for downwards regulation during the morning.

Constraints were active in Scotland for most of the day. Trades and BM Actions were required for thermal import constraints in the South East of England. BM actions assisted with system inertia. Trades were used for voltage control.