






Date: Sunday 16 Oct 2022

BSUoS Charge Estimate: £17.28/MWh
Total Outturn: £17.26m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

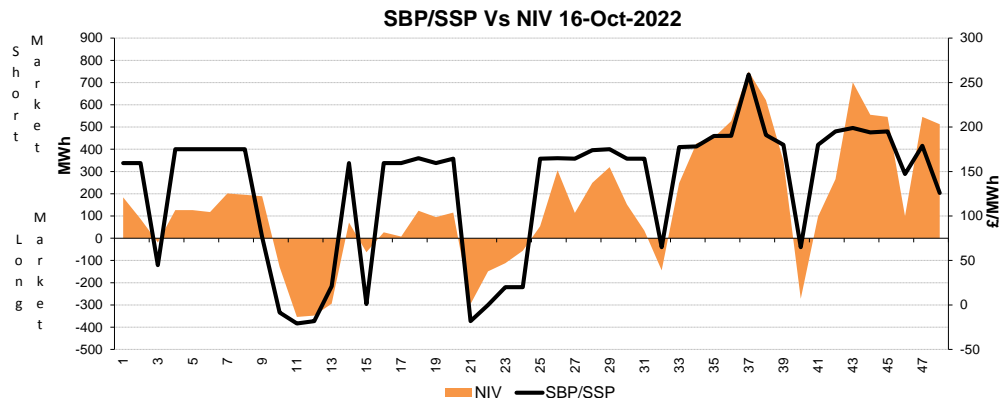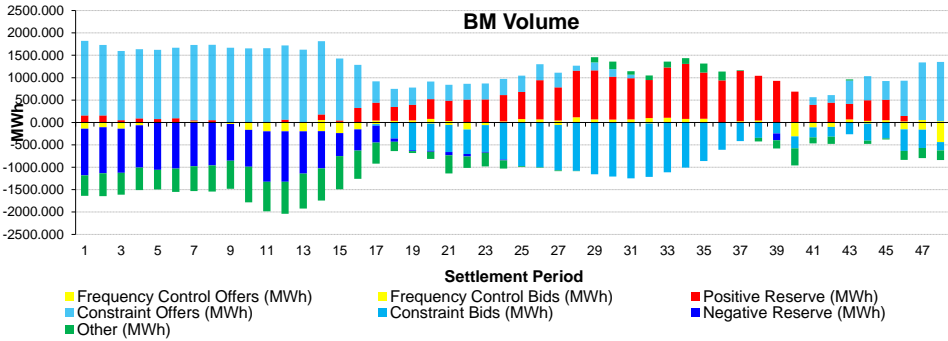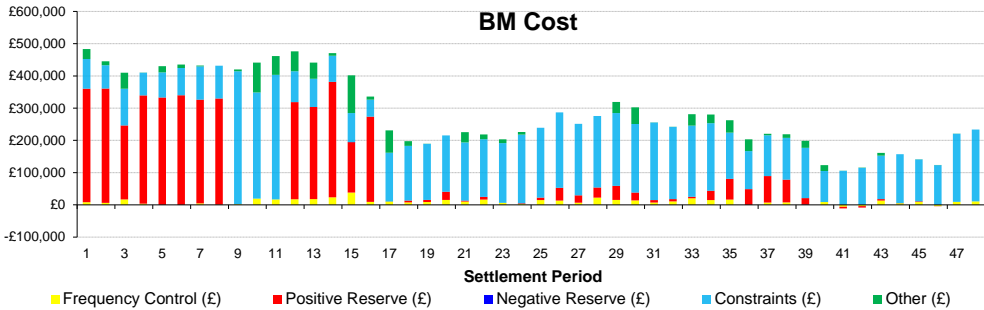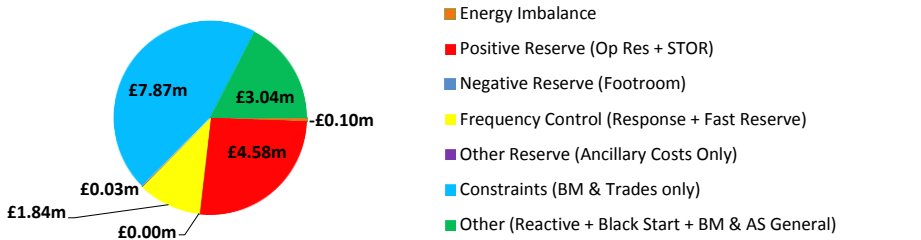

Commentary

The market alternated between long and short in the morning and was mostly short for the rest of the day. Trades were required for Downward Reg in the morning and for Margin in the evening. BM Actions managed thermal export constraints during the day. Trades alleviated thermal import constraints in the South East of England overnight. BM Actions assisted with System Inertia in the early morning. Trades and BM Actions were required for Voltage Control overnight.