






Date:

Saturday 22 Oct 2022

BSUoS Charge Estimate: £4.75/MWh  
Total Outturn: £4.42m

# Daily Balancing Costs

BM Cost (Indicative)  
AS Cost (Estimate)

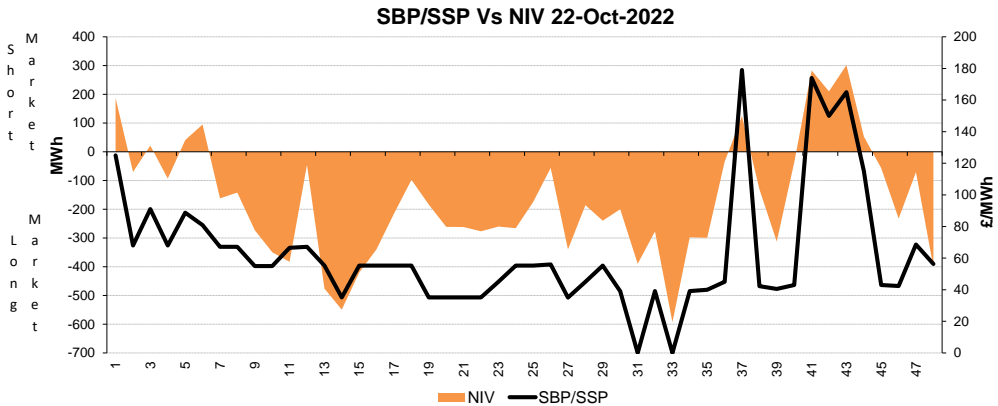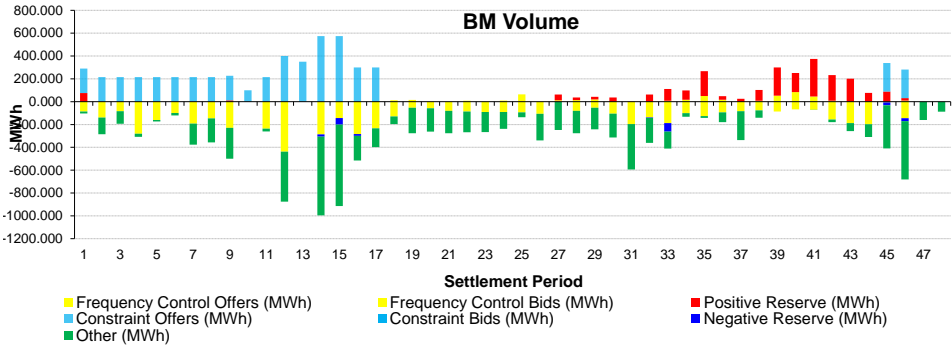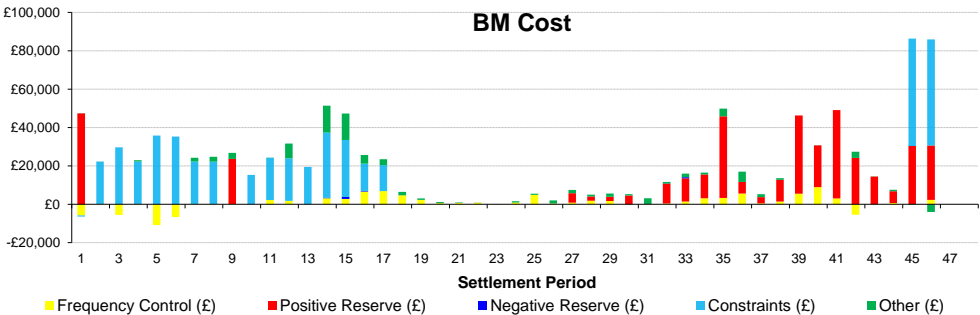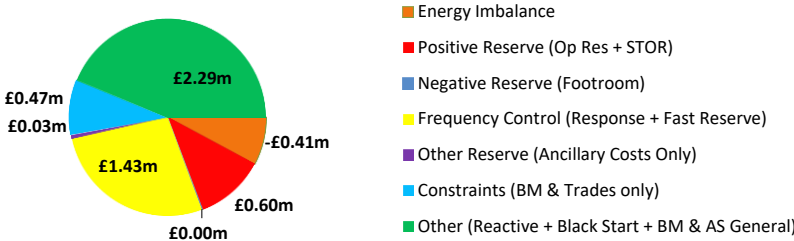

## Commentary

A mostly long market throughout the day except a few short periods overnight. Trades were required for Downward Regulation overnight.  
BM Actions and Trades were required for Voltage Control in the early morning and overnight. Trades managed thermal import constraints in the South East of England during the morning.