

Date: Saturday 01 Oct 2022

BSUoS Charge Estimate: £24.66/MWh






Total Outturn: £23.64m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

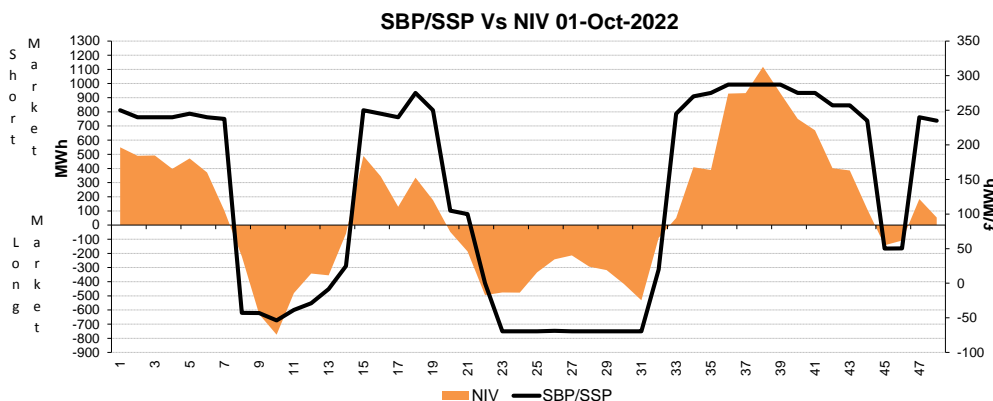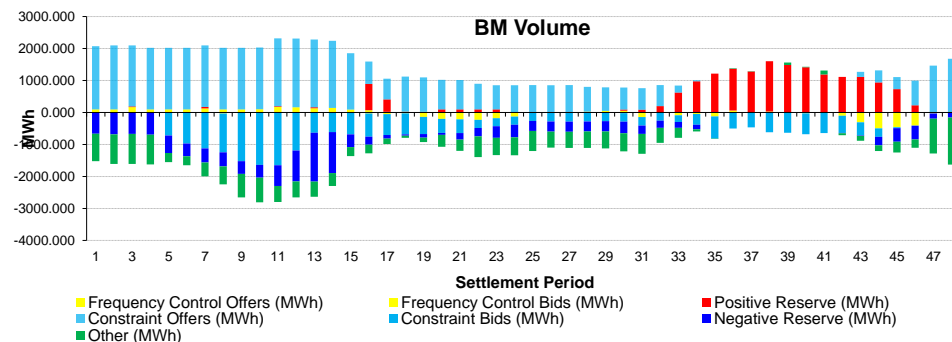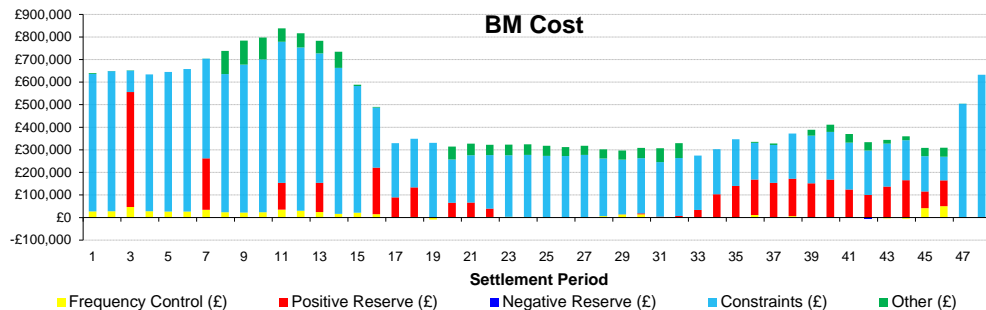

Commentary

The market was short overnight to the early hours, between 7am and 9.30am in the morning, and from late afternoon onwards. Interconnector Trades were required at the start of the day for Downward Regulation, and in the evening for Margin.

Overnight Trades and BM Action were required for Voltage Control. BM Action assisted with System Inertia during the day and overnight. BM Action managed thermal export constraints in Scotland and the North of England throughout the day.