

Date: Wednesday 05 Oct 2022

BSUoS Charge Estimate: £14.87/MWh






Total Outturn: £16.63m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

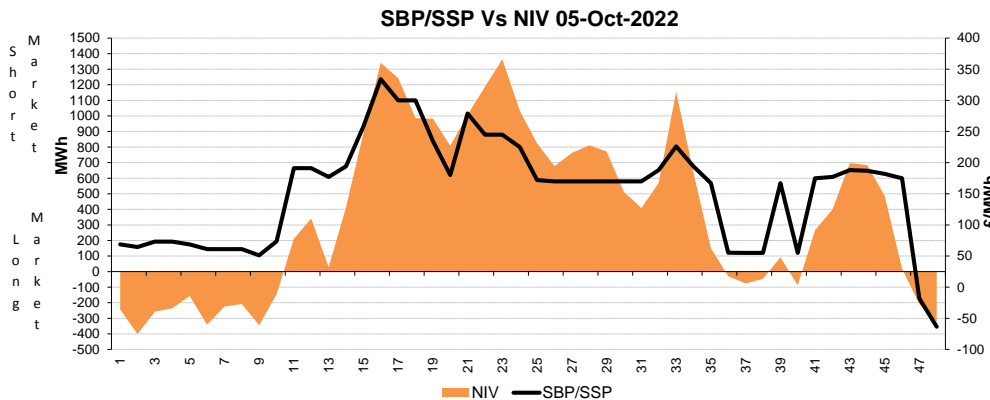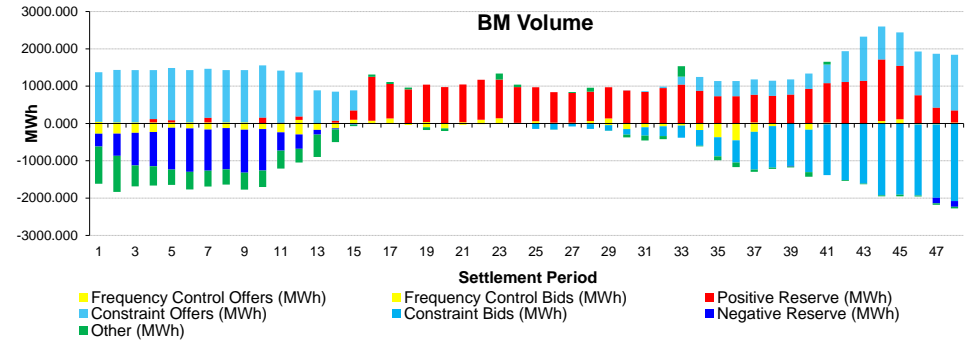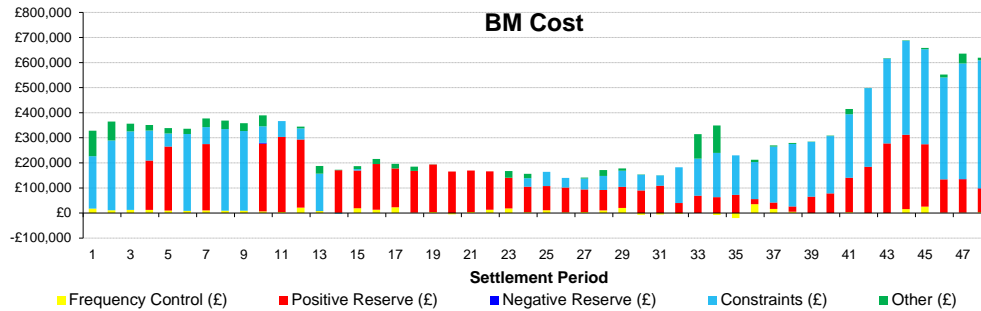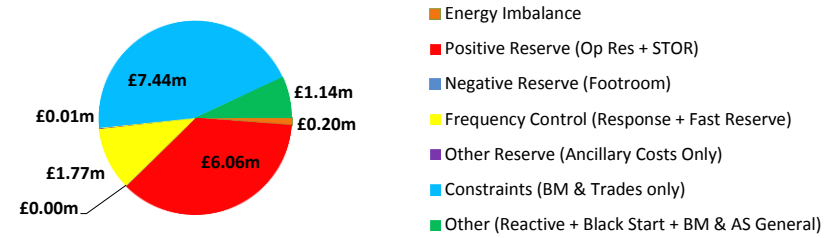

Commentary

The market was long until 5am and then short the rest of the day until 11pm. 250MW of Non-BM Fast Reserve was run in the early evening. Trades were required at the start and end of the day for Downward Regulation and in the evening for Margin.

BM Action were required for System Inertia in the morning. Trades and BM Actions were used for Voltage Control throughout the morning. BM Actions managed thermal export constraints in Scotland from mid afternoon.