

Date:


Sunday 12 Dec 2021

BSUoS Charge Estimate: £6.03/MWh

Total Outturn: £7.52m


BM Cost (Indicative)

AS Cost (Estimate)






## Daily Balancing Costs

**nationalgrid**ESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

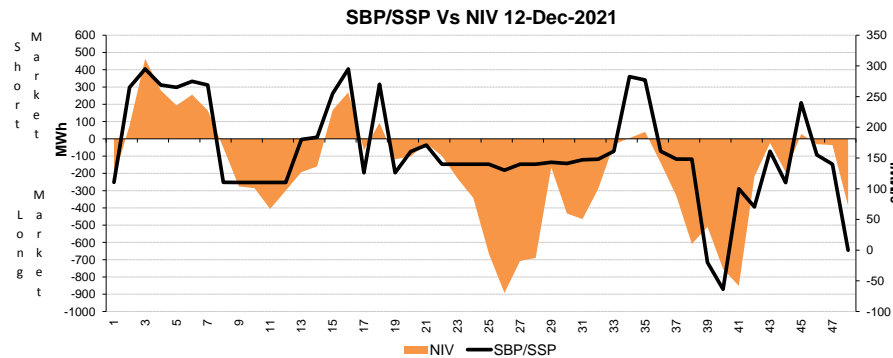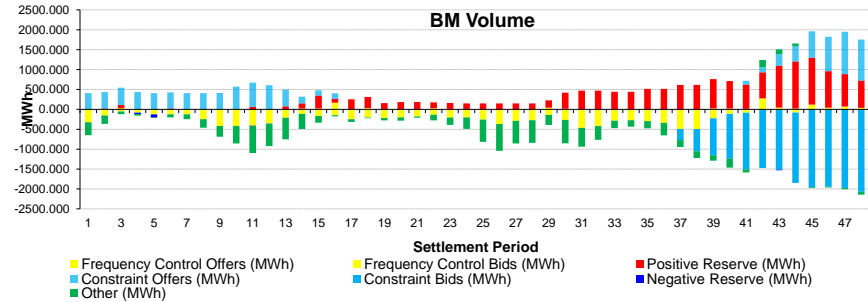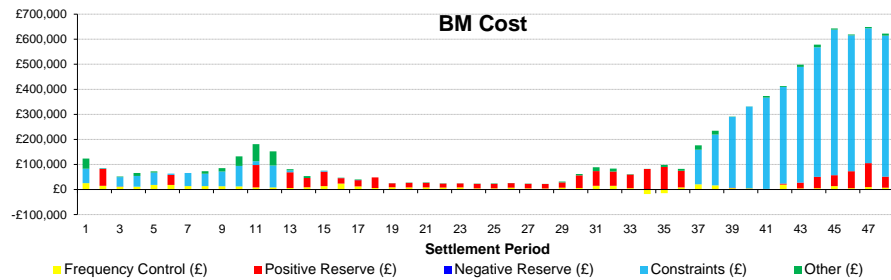

### Commentary

A mostly long market from mid morning onwards. Interconnector Trades were required for Downward Regulation between 6am and 7am, and for Margin from 3pm to 10pm.

Overnight Voltage Control supported by Trades in the South and South East of England, and BM Action in the Midlands and Wales area. BM Action assisted with RoCoF overnight. BM Action managed thermal export constraints in Scotland from early evening onwards, and in the North West of England during the evening.