



Date: Saturday 18 Dec 2021




BSUoS Charge Estimate: £3.79/MWh
Total Outturn: £4.86m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

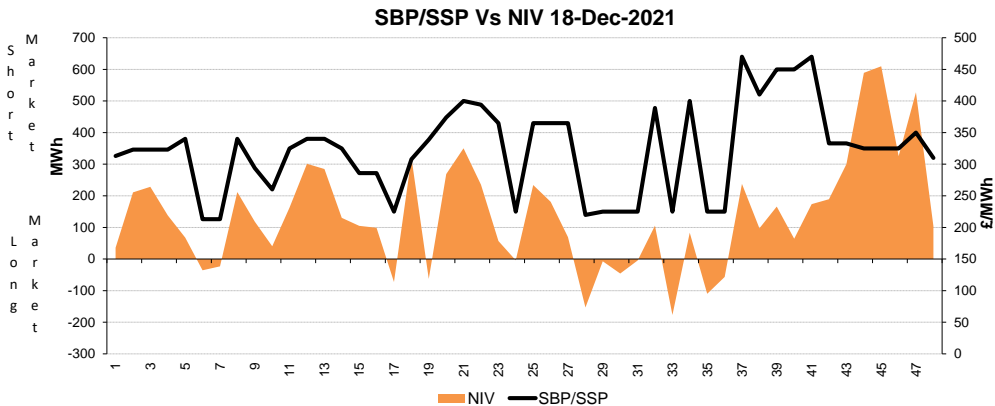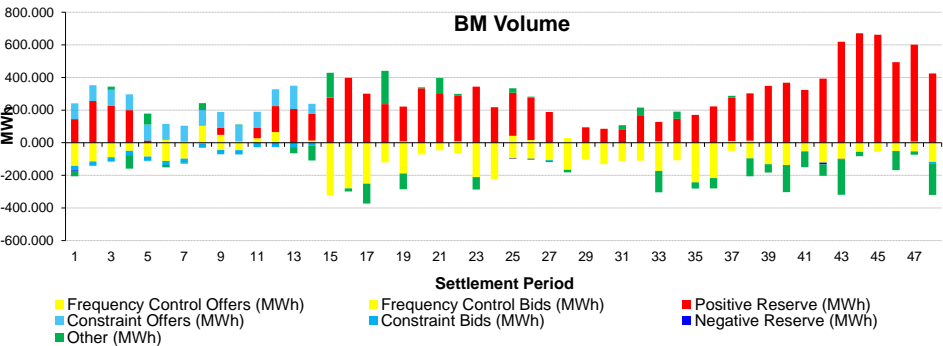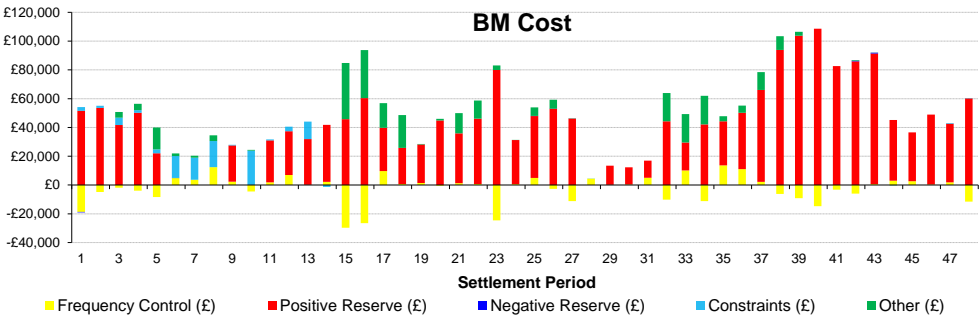

Commentary

The market was short in excess of 600MW in the morning and in the afternoon, and in excess of 1200MW in the late evening. Multiple trades on the interconnectors were required over the morning peak for positive margin. BM actions were taken until the early afternoon to solve power flow restrictions in Wales, due to planned outages. Overnight, offers were accepted in the BM to manage the voltage levels in England.