

Date:


Wednesday 22 Dec 2021

BSUoS Charge Estimate: £5.75/MWh

Total Outturn: £8.91m


BM Cost (Indicative)

AS Cost (Estimate)






Daily Balancing Costs

nationalgridESO



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

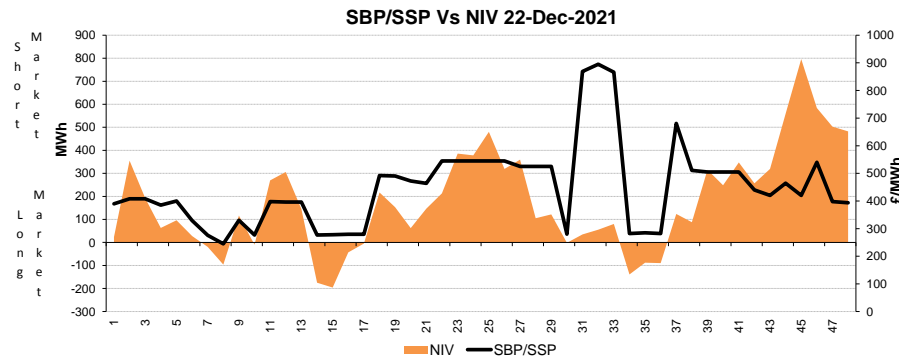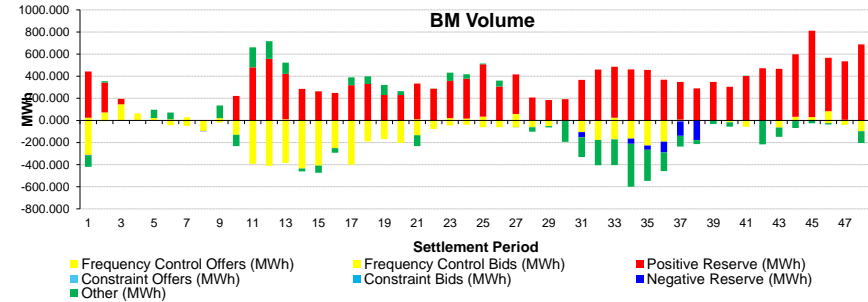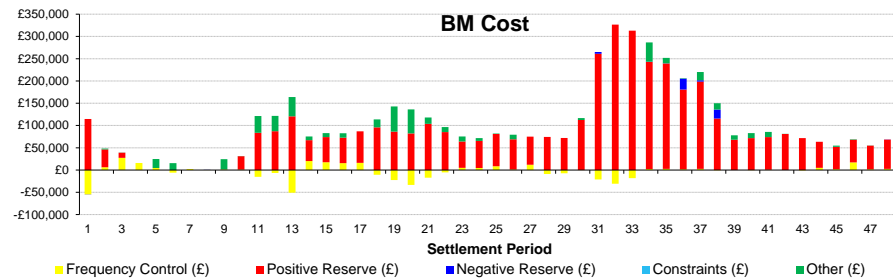

Commentary

A short market from morning onwards. Interconnector Trades were required for Margin between 5am and 10am. No active constraints during the day. Voltage Control and System Inertia were adequate with no BM intervention required.