

Date: Friday 17 Dec 2021






BSUoS Charge Estimate: £1.82/MWh
Total Outturn: £2.07m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

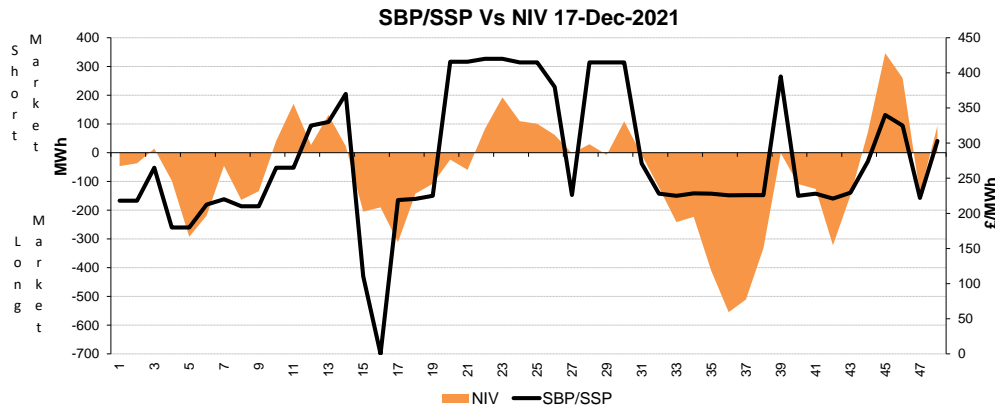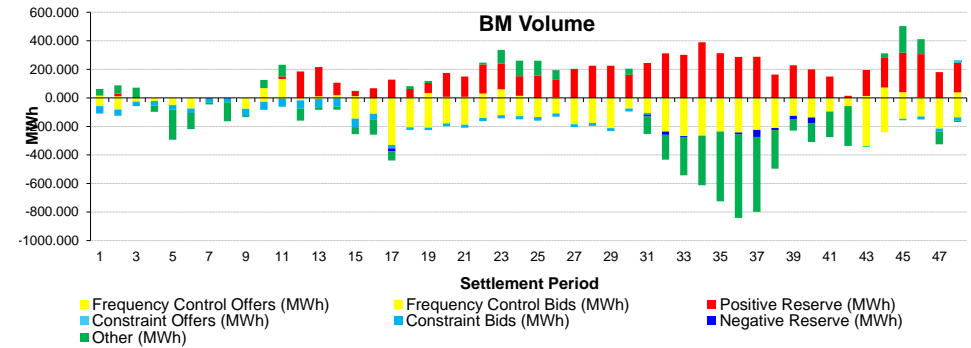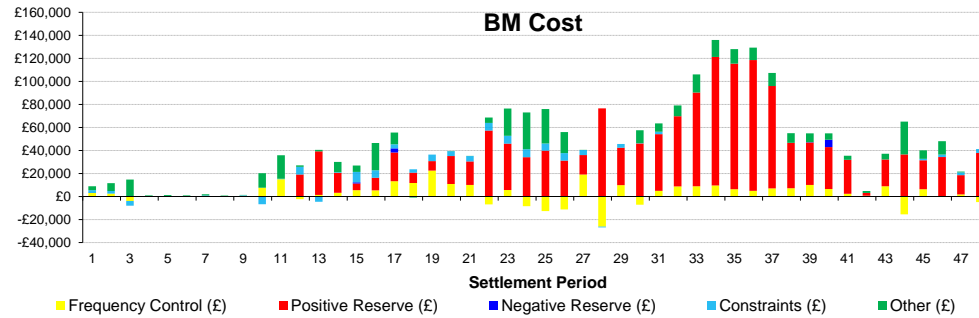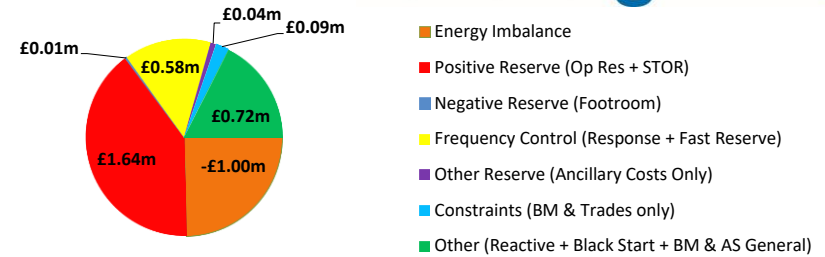

Commentary

Periods of short markets in excess of 400MW were recorded in the morning, and in excess of 600MW in the late evening. Trades on the interconnectors were undertaken for positive margin before midnight. Between Midnight and the afternoon, BM actions were required to solve power flow restrictions in Wales due to planned outages.