


Date: Saturday 25 Dec 2021





BSUoS Charge Estimate: £12.89/MWh
Total Outturn: £15.17m

BM Cost (Indicative)
AS Cost (Estimate)



Daily Balancing Costs

nationalgridESO

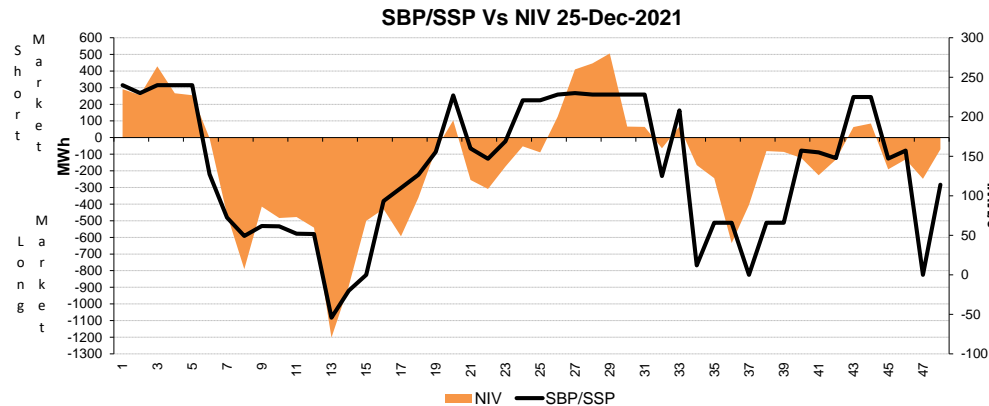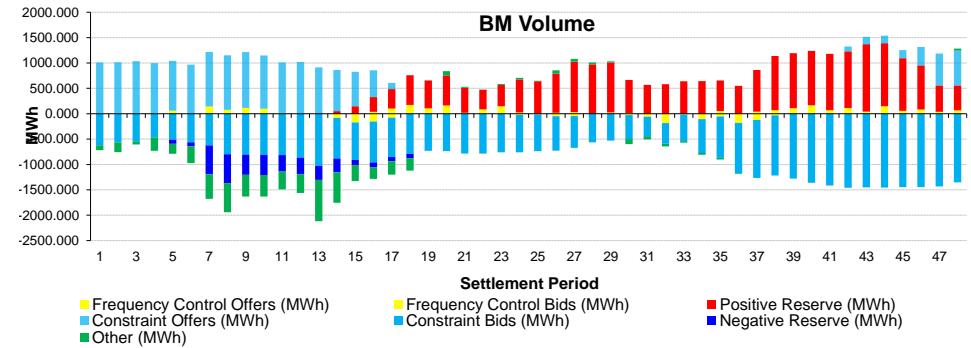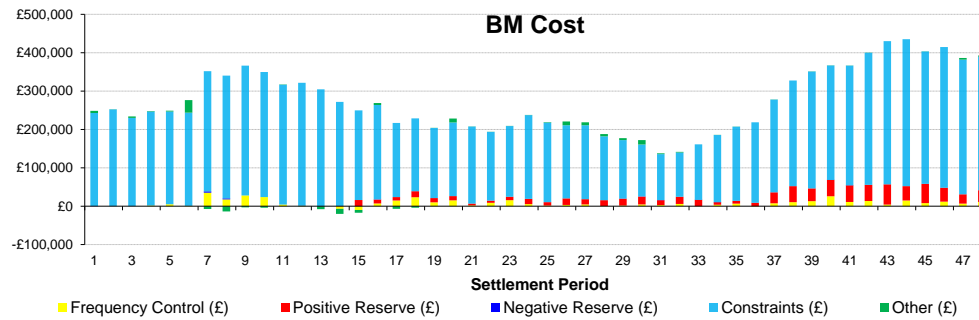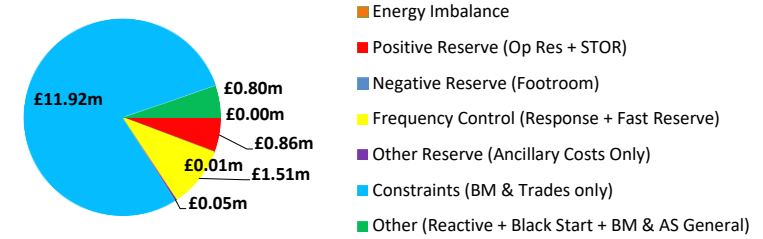

Commentary

The market was short in excess of 800MW over a few settlement periods after midnight and in the afternoon. Over the morning pick-up multiple trades on the interconnectors were undertaken for downward regulation. High volume of BM actions were required throughout the 24 hours to solve power flow restrictions on the network boundary between England and Scotland due to high wind level. A mix of trades and BM actions were taken overnight to manage the voltage levels in England. Some intervention was also required in the BM for RoCoF.