

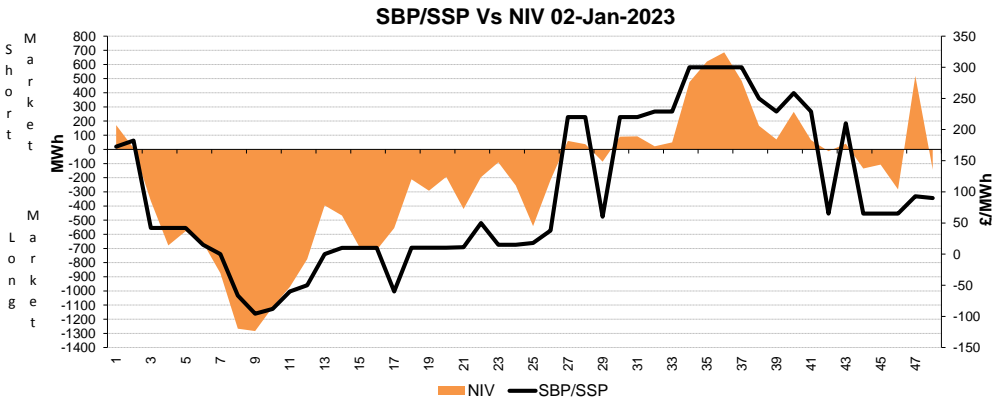
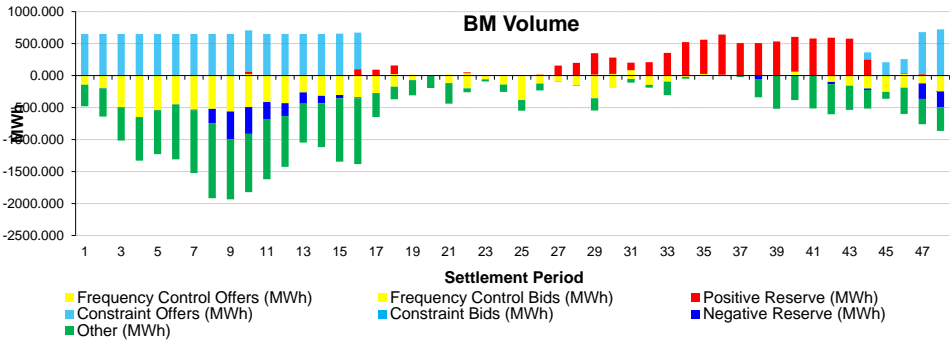
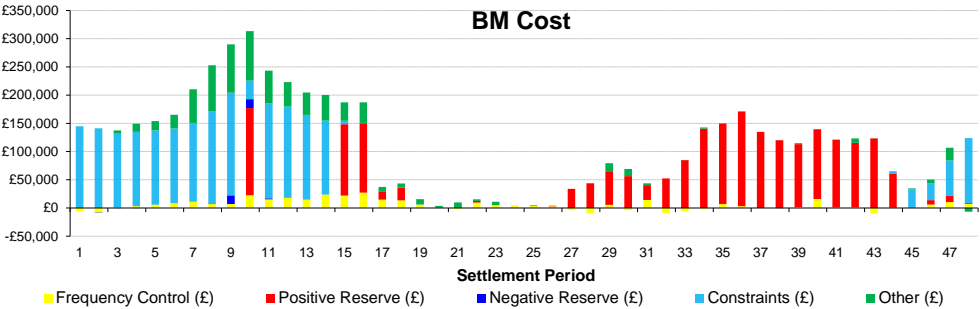


Daily Balancing Costs

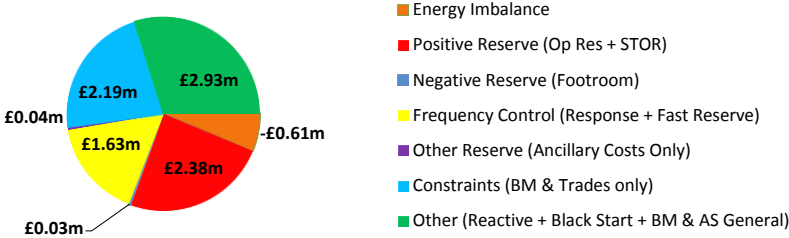

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was mostly long in the morning and then mostly short from afternoon onwards. Trades were required for Downward Regulation overnight.

BM Actions and Trades supported overnight Voltage Control. BM Actions assisted with System Inertia.