

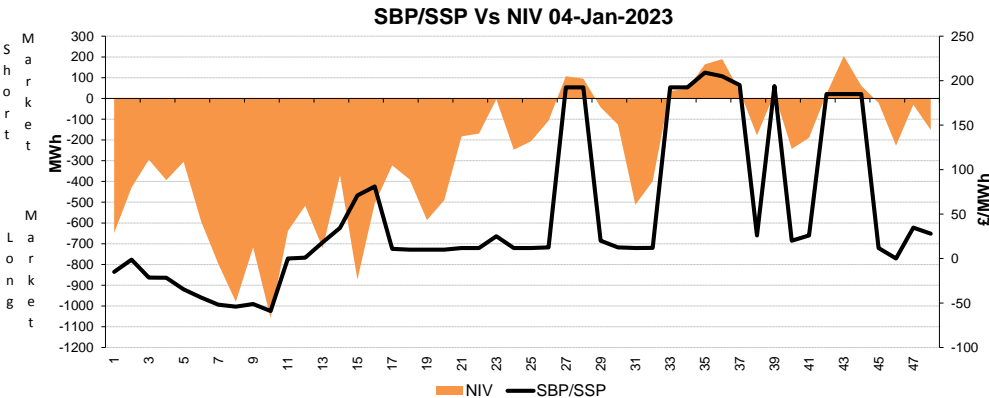
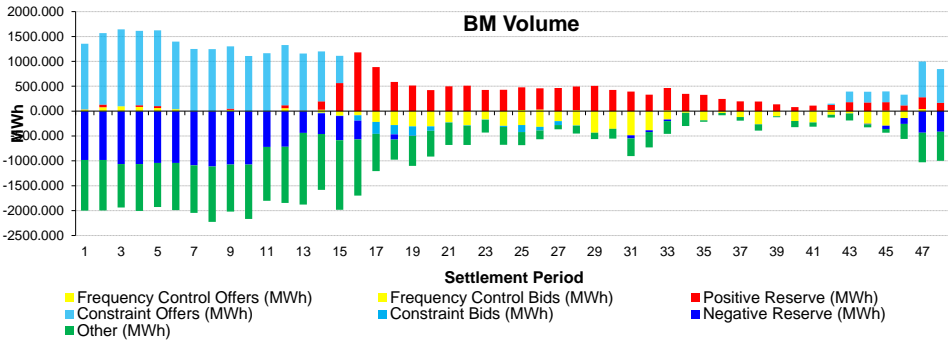
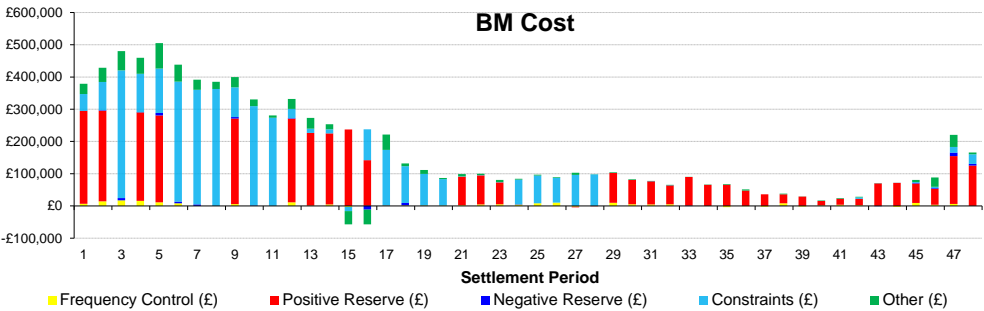


Daily Balancing Costs

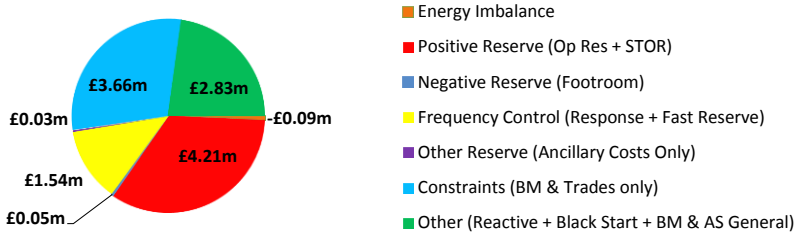

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was long in the morning and then alternated between long and short in the afternoon and evening. Trades were required for Downward Regulation in the early morning and overnight. BM Actions and Trades managed thermal export constraints in Scotland and the North of England in the late morning and early afternoon. BM Actions and Trades support overnight Voltage Control. BM Actions assisted with System Interia.