



Date: Monday 30 Jan 2023

BSUoS Charge Estimate: £10.88/MWh
Total Outturn: £15.08m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

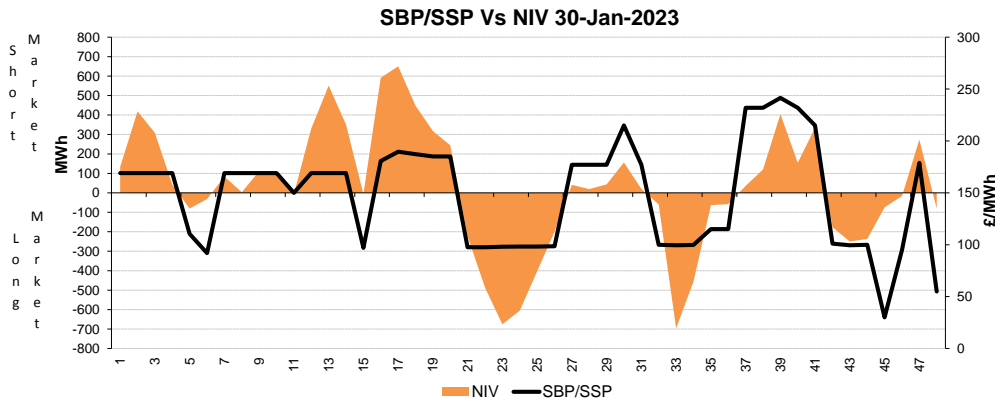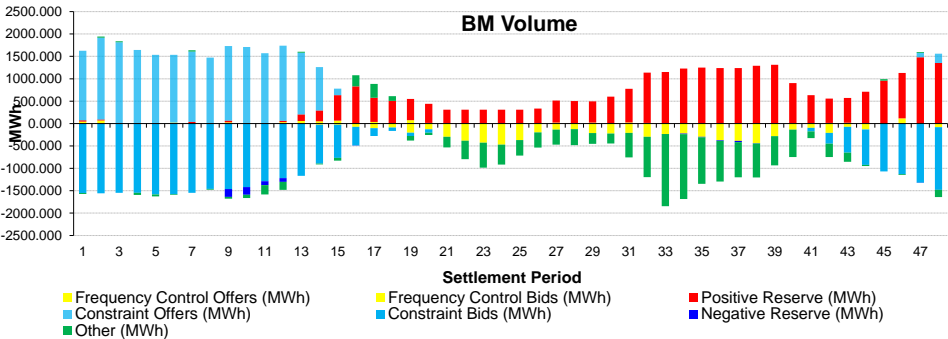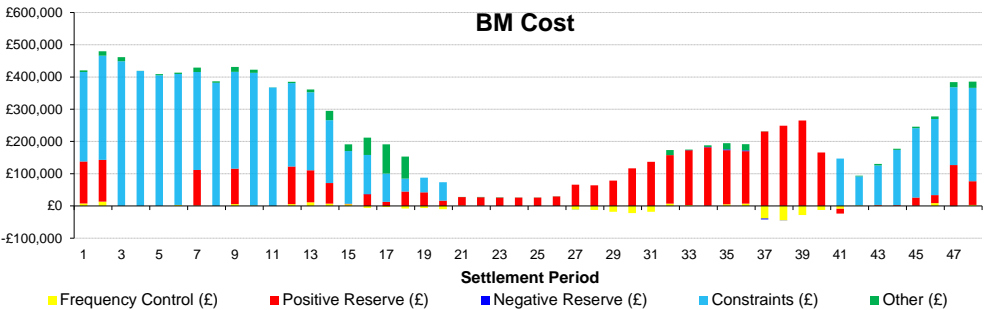

Commentary

The market remained mostly short in the morning and then fluctuated for the rest of the day. Trades were required for Downward Regulation around mid morning and Margin in the late morning. BM Actions and Trades were required for overnight Voltage Control. BM Actions also assisted with System Inertia. Thermal export constraints were managed by BM Actions in the early morning and late night.