

Date:

Tuesday 24 Jan 2023

BSUoS Charge Estimate: £5.55/MWh



Total Outturn: £8.46m

Daily Balancing Costs




nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

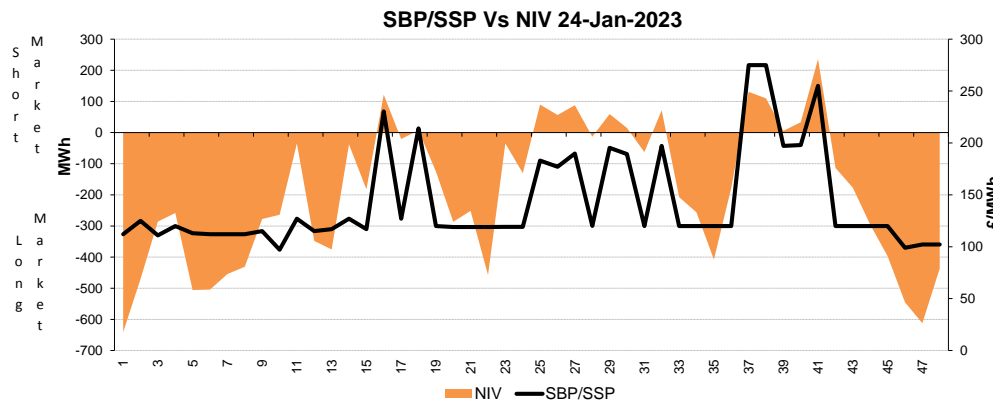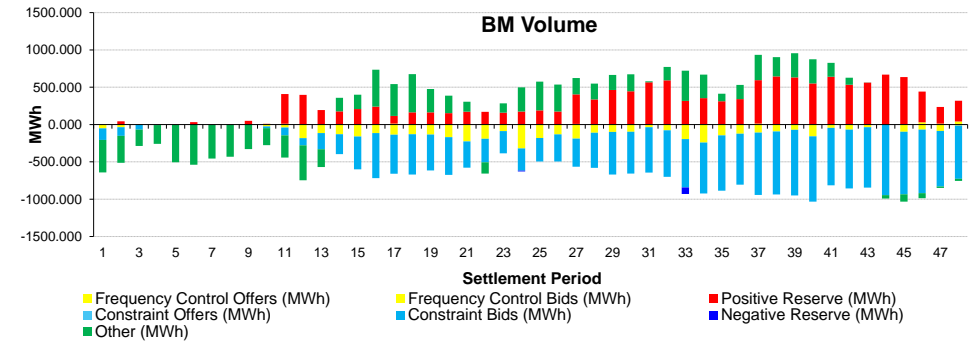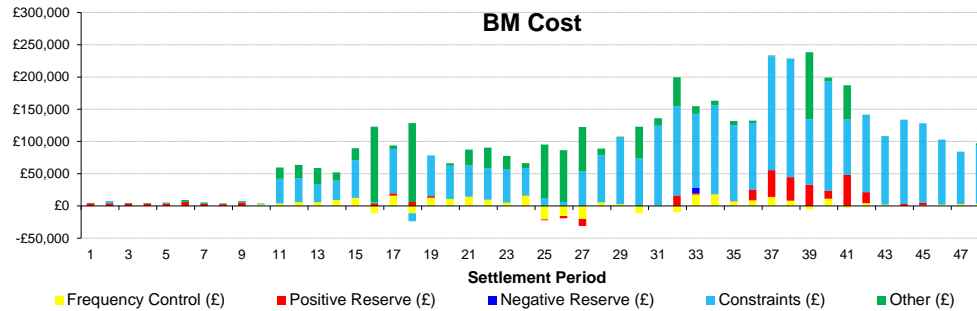

Commentary

The market position was mostly long throughout the day. Trades were made for margin from early morning until late in the evening.

Some constraints were active in Scotland all day. More became active during the mid-afternoon period. All voltage and inertia requirements were met by the market.