



Date: Thursday 04 Feb 2021




BSUoS Charge Estimate: £2.33/MWh
Total Outturn: £3.44m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

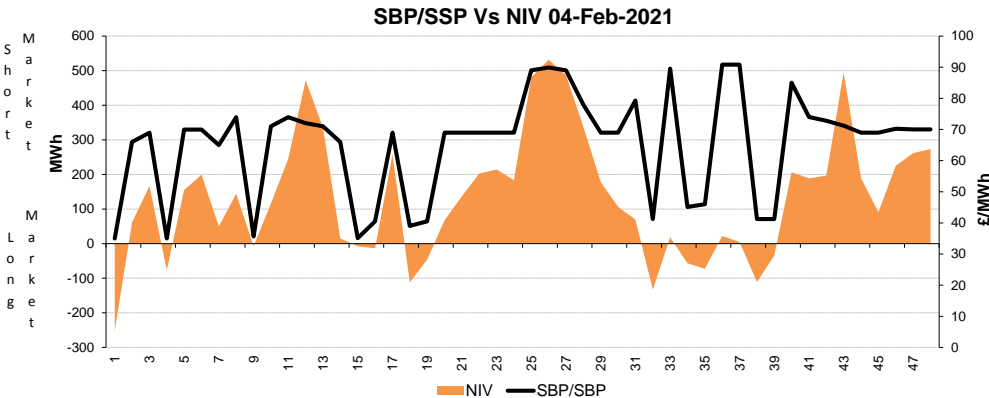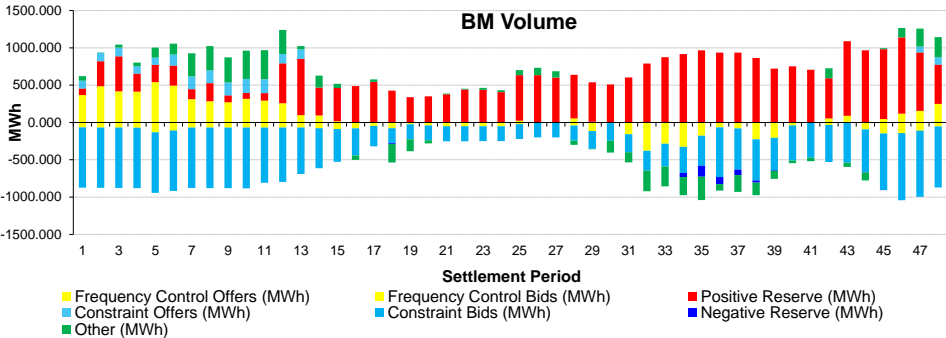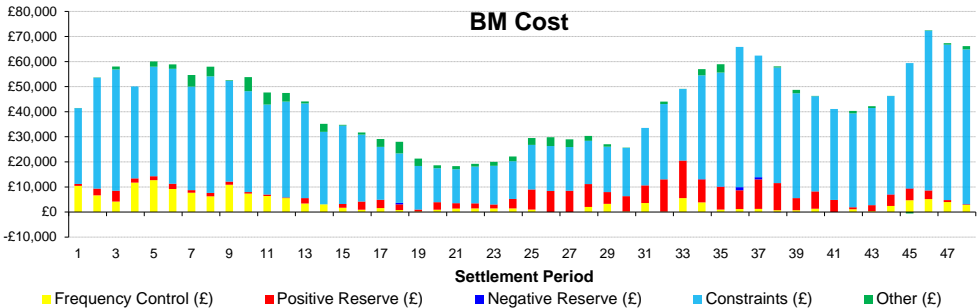

Western Link status: Available

Commentary

A predominantly short market throughout the day. Interconnector Trades overnight and BM Action for RoCoF. Some BM Action early morning for Voltage Control in the Midlands. BM Action alleviated thermal export constraints in the North of Scotland from late afternoon into the night.