



Date: Saturday 13 Mar 2021

BSUoS Charge Estimate: £4.22/MWh  
Total Outturn: £5.08m




BM Cost (Indicative)  
AS Cost (Estimate)



# Daily Balancing Costs

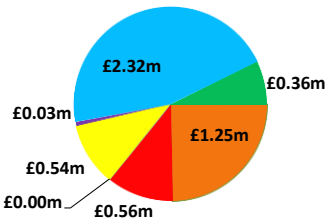

- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

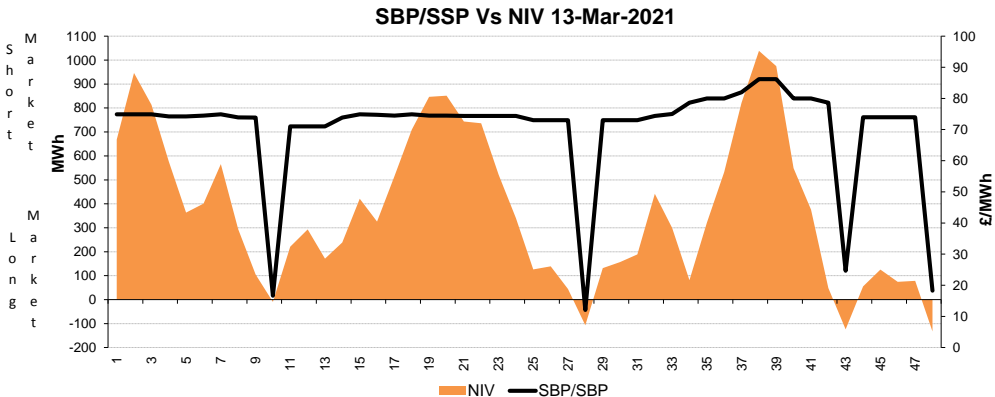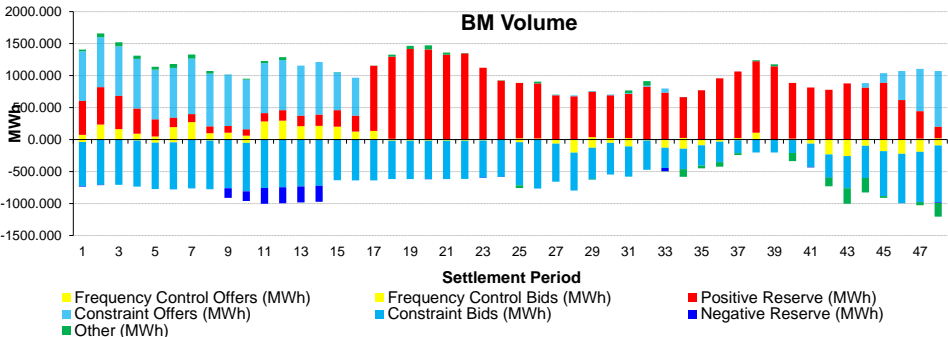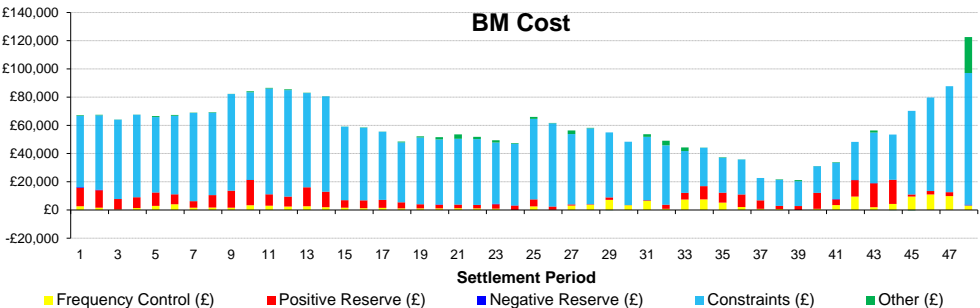

Western Link status: Unavailable

## Commentary

The market was significantly short throughout the day. Trades were made for downwards regulation overnight.

Some thermal constraints were active in Scotland in the afternoon and into the evening. Trades and BM Actions were used for RoCoF. A combination of an optional contract enactment, trades and BM actions were required for voltage management.