


Date: Thursday 24 Mar 2022

BSUoS Charge Estimate: £3.31/MWh

Total Outturn: £3.62m





BM Cost (Indicative)

AS Cost (Estimate)



# Daily Balancing Costs

nationalgridESO

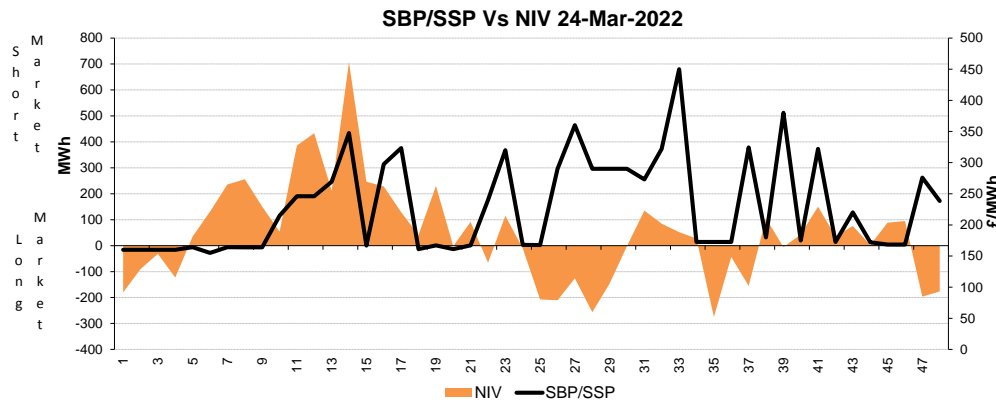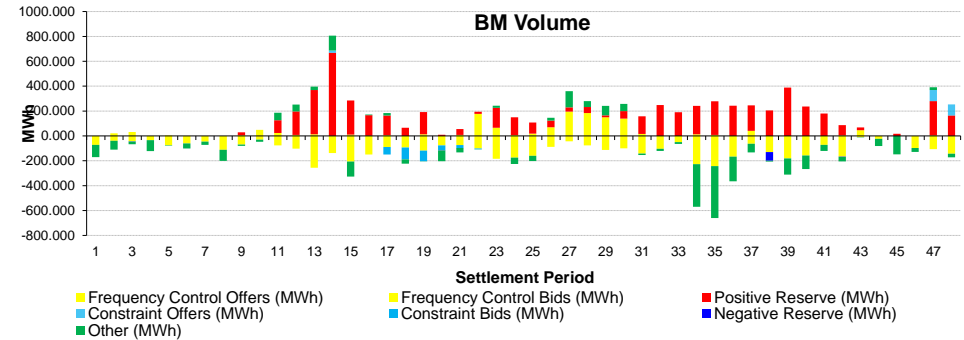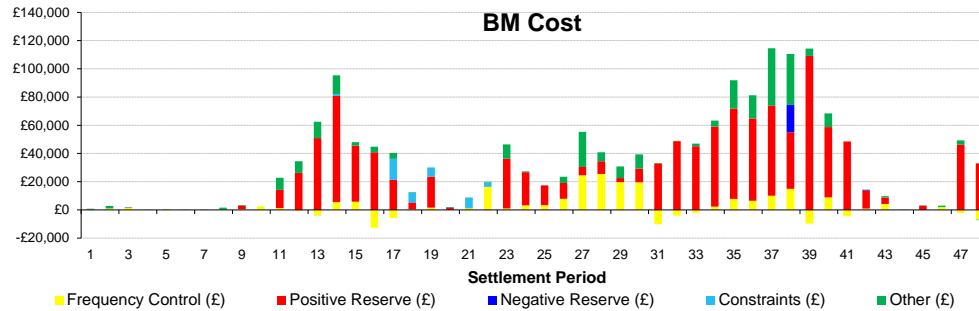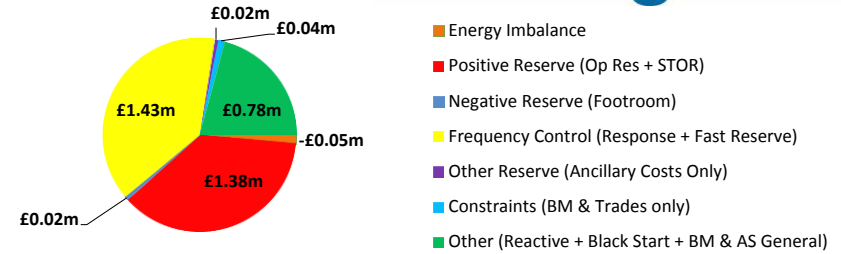

## Commentary

The market was short over parts of the early morning, midday to mid afternoon, and at times during the early evening. Interconnector Trades were required for Margin between 5am and 7am in the morning, and from 5pm to 7pm in the early evening.

Overnight Voltage Control supported by Trades in the North East of England. BM Action was required to manage thermal export constraints in the South East of England during the morning.