






Date: Wednesday 30 Mar 2022

BSUoS Charge Estimate: £3.85/MWh
Total Outturn: £4.86m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)
AS Cost (Estimate)

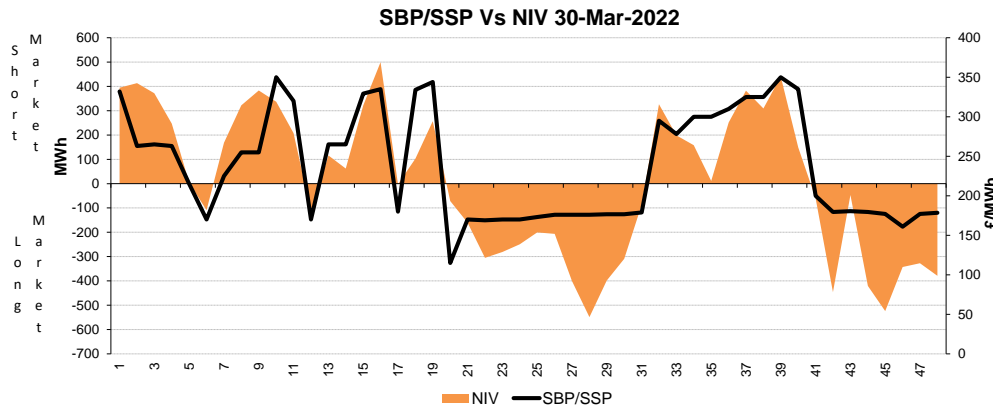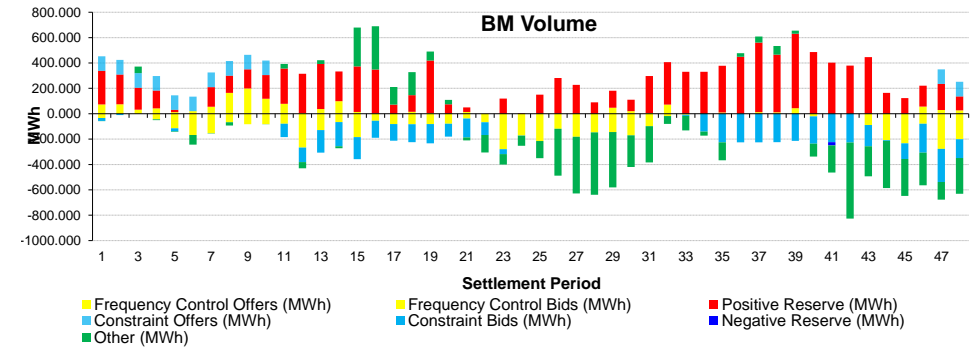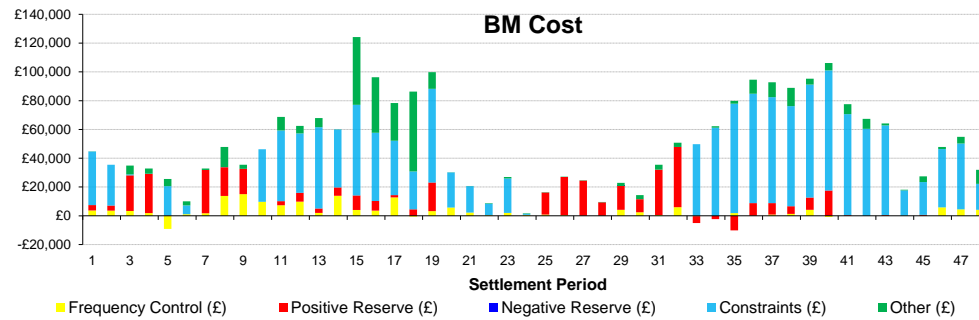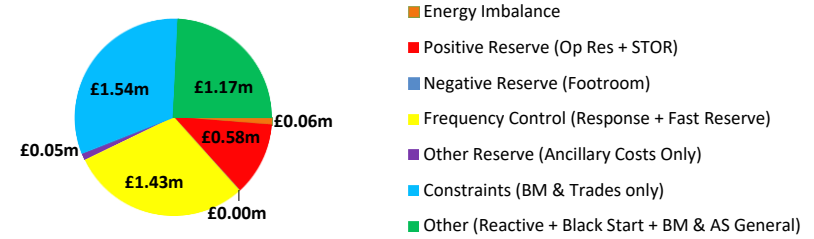

Commentary

The market was short in excess of 800MW in the morning and in the evening. Multiple trades on the interconnectors were undertaken over the morning peak for positive margin. Some BM actions were required overnight to mitigate power flow restrictions on the network boundary between England and Scotland. Trades on generating units were taken overnight to manage the voltage levels in England.