






Date: Wednesday 15 Mar 2023

BSUoS Charge Estimate: £3.90/MWh  
Total Outturn: £5.12m

Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)

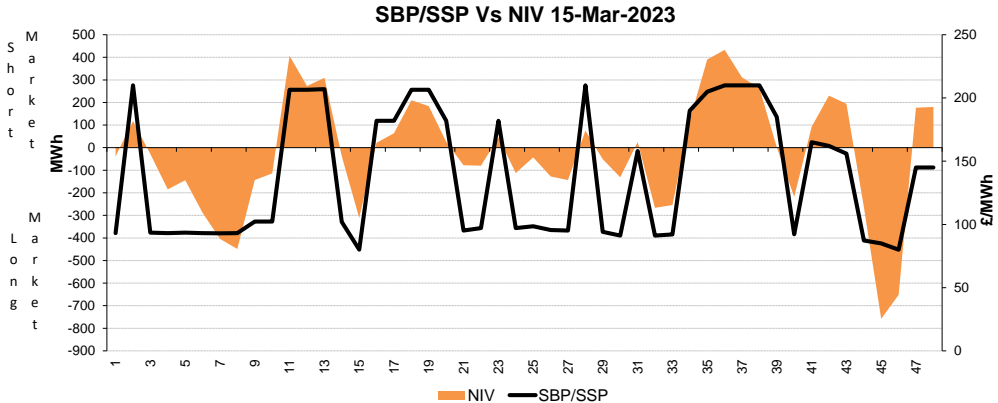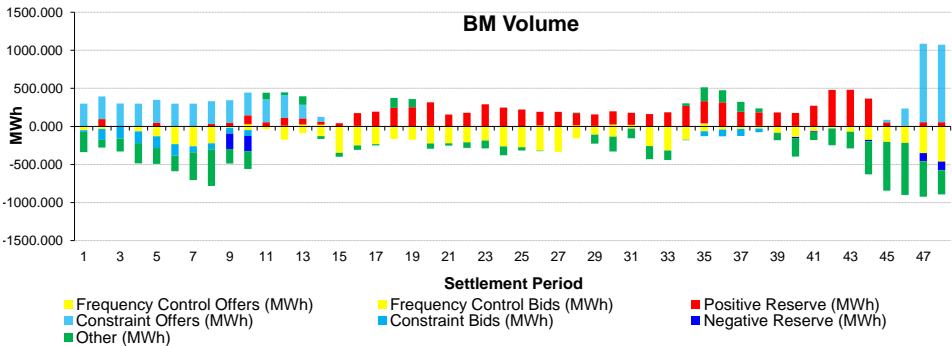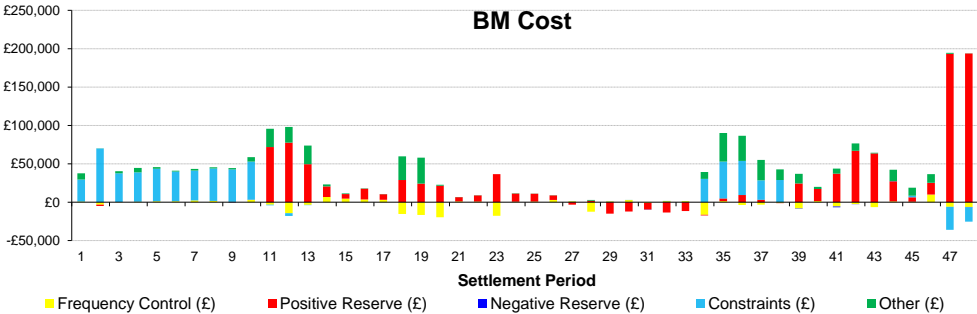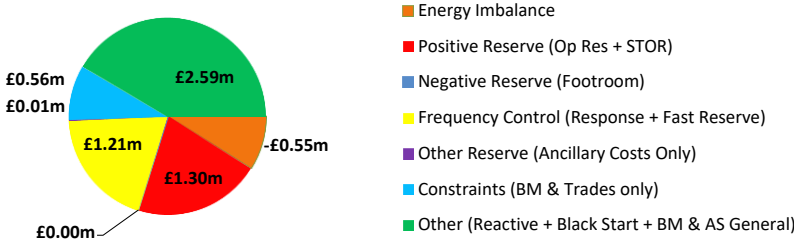

Commentary

The market fluctuated between long and short throughout the day. Trades were required for Downward Regulation. Contrain actions were required early morning and afternoon in Scotland. Trades and BM Actions were needed for Voltage Control. BM Actions were required for Inertia.