



Date: Saturday 18 Mar 2023




BSUoS Charge Estimate: £3.46/MWh
Total Outturn: £3.40m

Daily Balancing Costs

BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

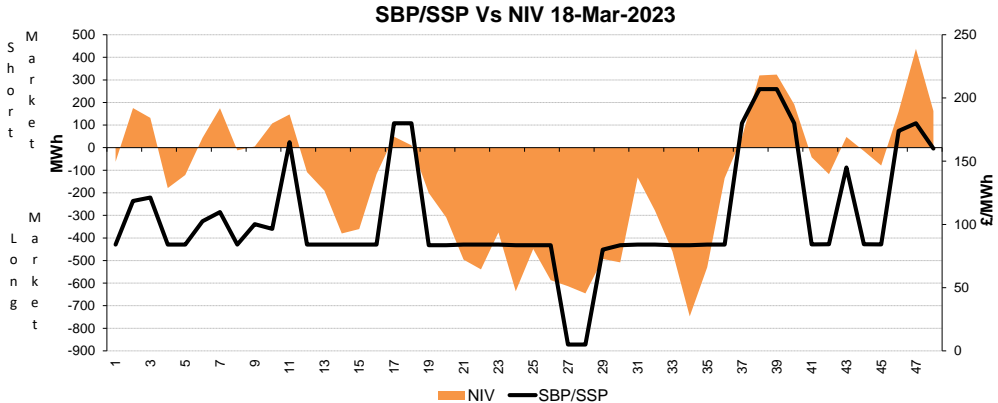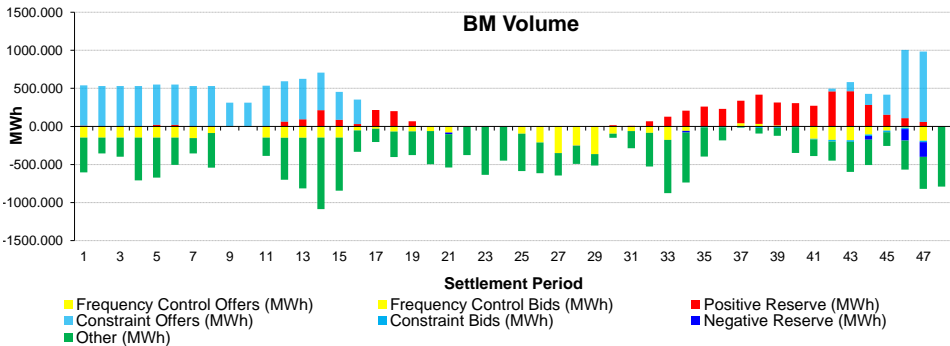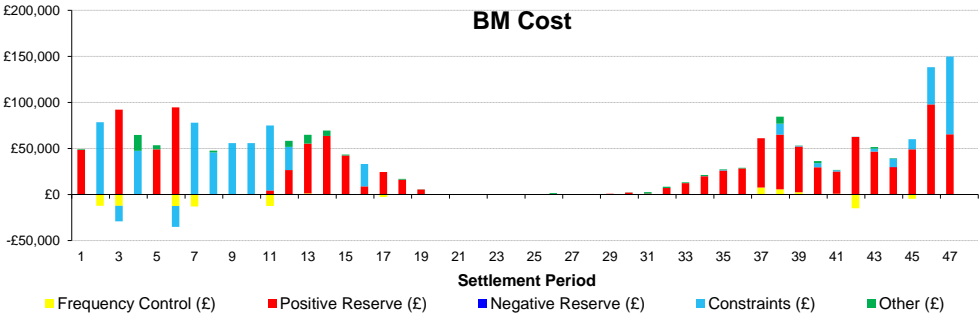

Commentary

The market fluctuated through most of the morning before remaining long until the evening where it began to fluctuate again between long and short. Trades were required for Downward Regulation in the late night. No constraints were active. BM Actions and trades assisted with overnight Voltage Control.