

Date: Thursday 23 Mar 2023






BSUoS Charge Estimate: £10.37/MWh
Total Outturn: £12.26m

Daily Balancing Costs

nationalgridESO

BM Cost (Indicative)

AS Cost (Estimate)

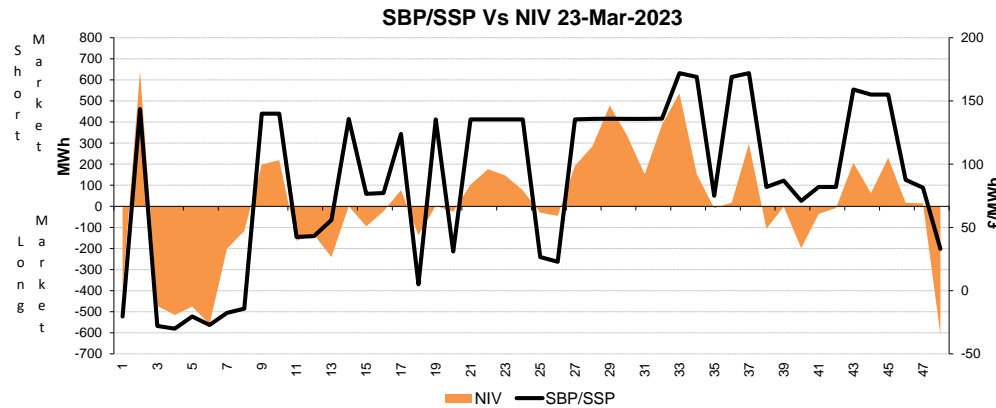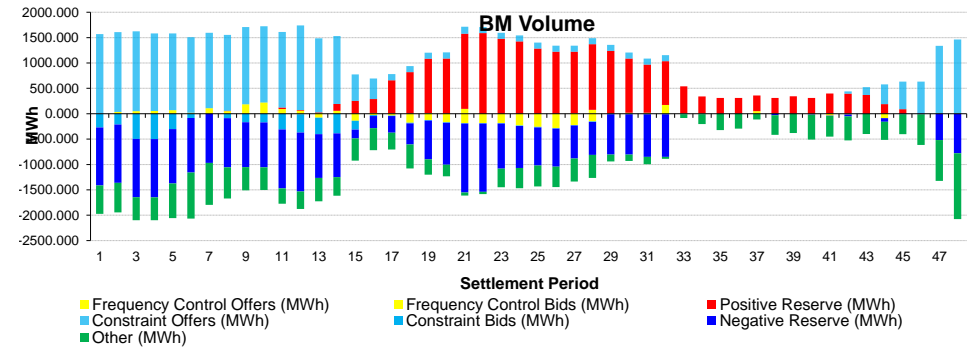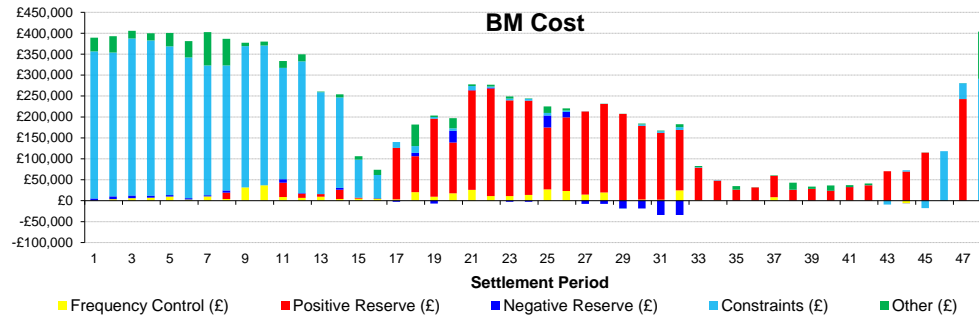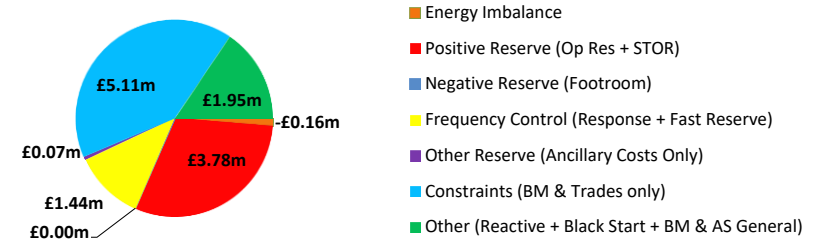

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation most of the day. BM Actions managed Thermal Constraints in Scotland and North of England. BM Actions and Trades were required for Voltage Control. BM Actions supported System Inertia.