

Date:


Thursday 28 Oct 2021

BSUoS Charge Estimate: £6.13/MWh

Total Outturn: £7.38m





BM Cost (Indicative)

AS Cost (Estimate)



## Daily Balancing Costs

nationalgridESO

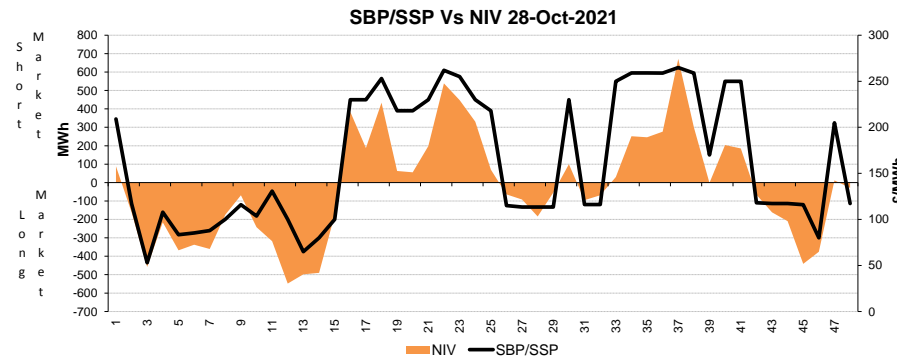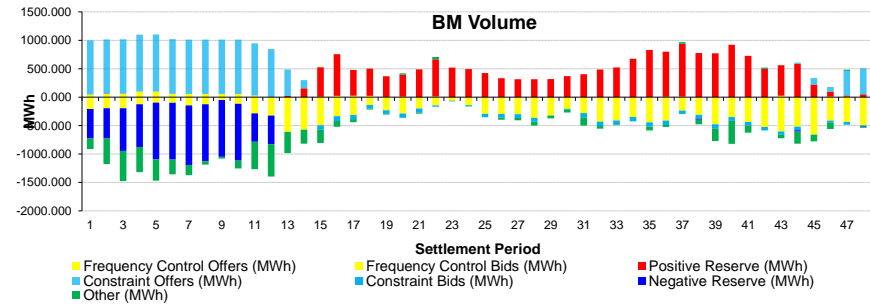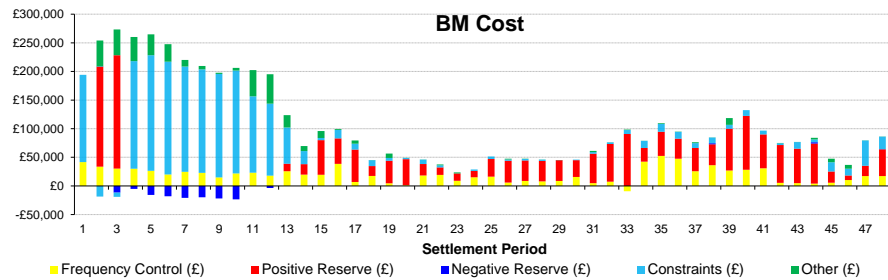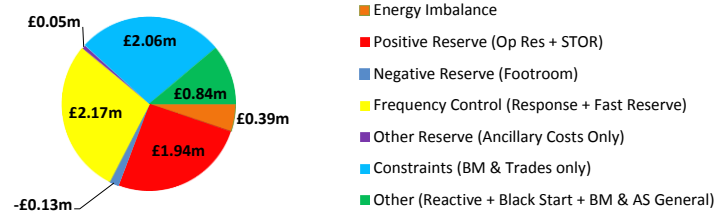

### Commentary

A long market overnight and during the early hours, becoming mostly short from morning onwards until the late evening. Interconnector Trades were required for Downward Regulation overnight to 6am, and for Margin between 7am and 8am. Overnight Voltage Control supported mostly by Trades for the Midlands, South and South East of England, with BM Action for the Wales area. BM Action assisted System Inertia overnight. BM Action alleviated thermal export constraints in the Wales area from morning onwards.