

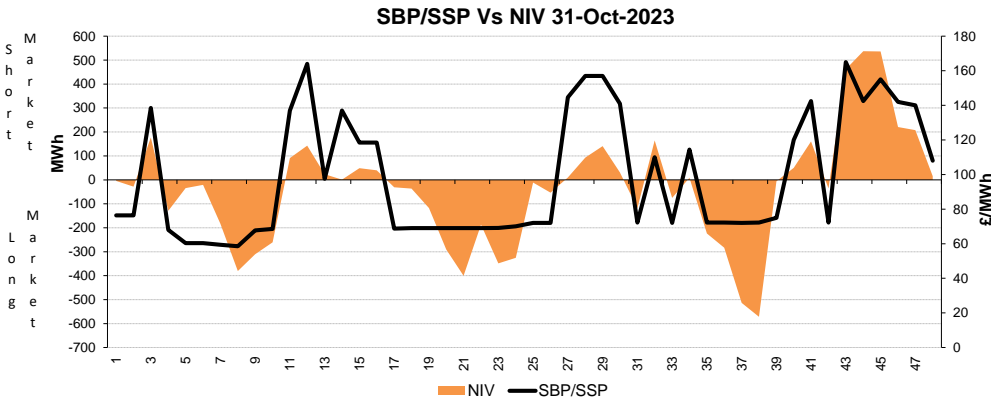
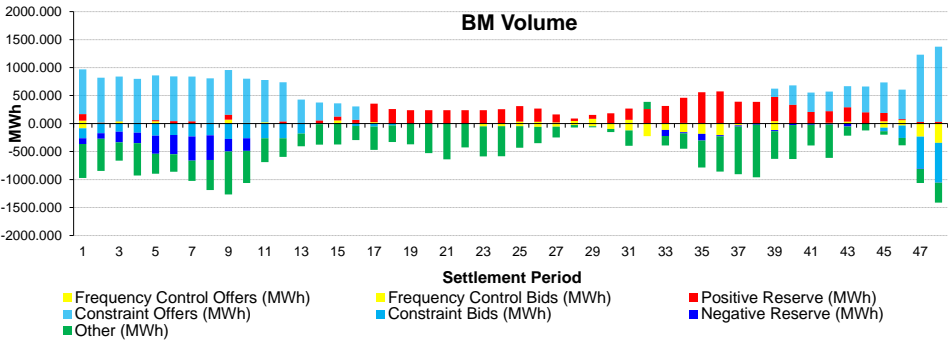
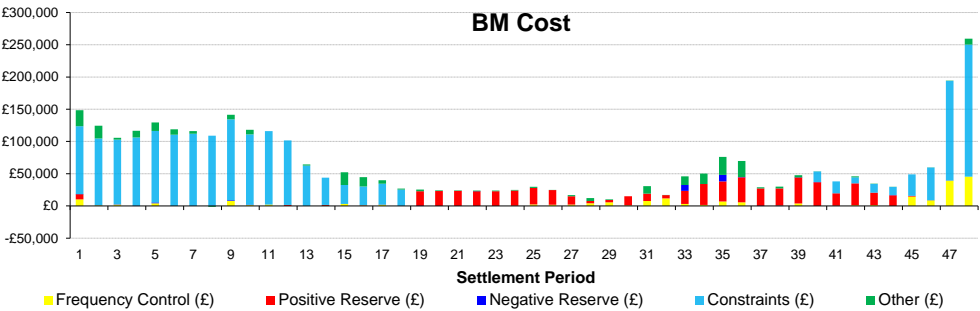


Daily Balancing Costs

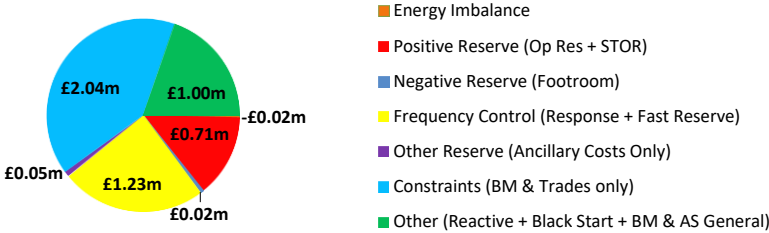

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market position alternated throughout the day. Trades were required for Margin and Downward Regulation.

BM Actions managed thermal constraints in Scotland and Northern England through the morning till 09:00am, then later on in the evening from 10:00pm onwards. Trades and BM Actions supported voltage control.