

Date:

Friday 26 Jan 2024

BSUoS Final Tariff: £14.04/MWh



Total Outturn: £12.21m

# Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

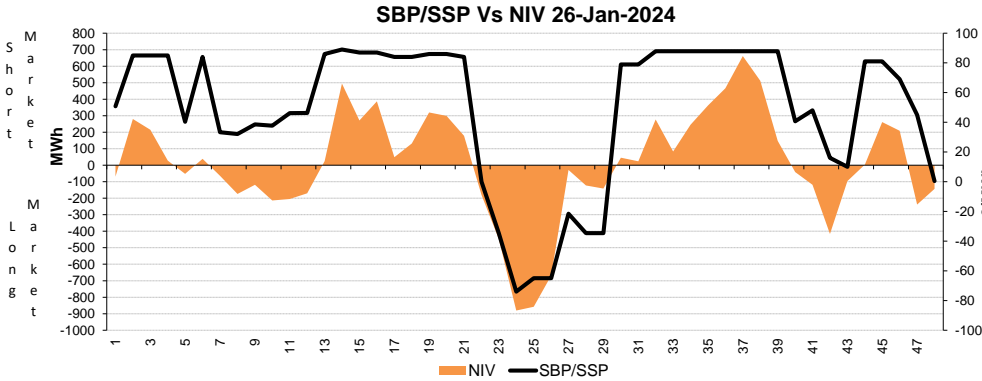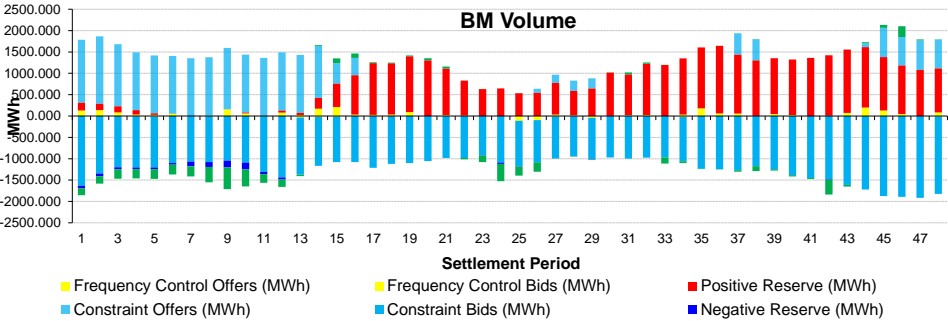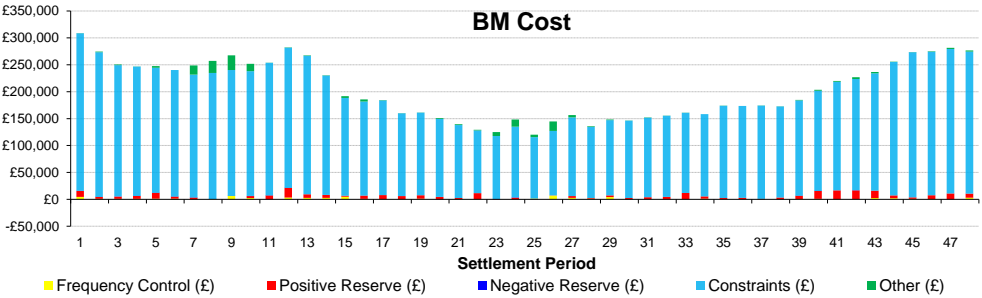

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions supported Voltage Control. BM Actions supported System Inertia. Trades and BM Actions helped manage thermal constraints in North England, South East England and Scotland throughout the day.