

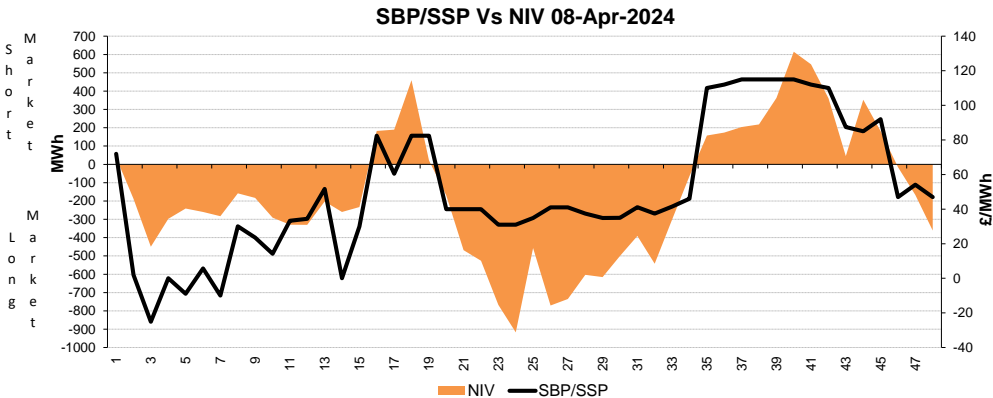
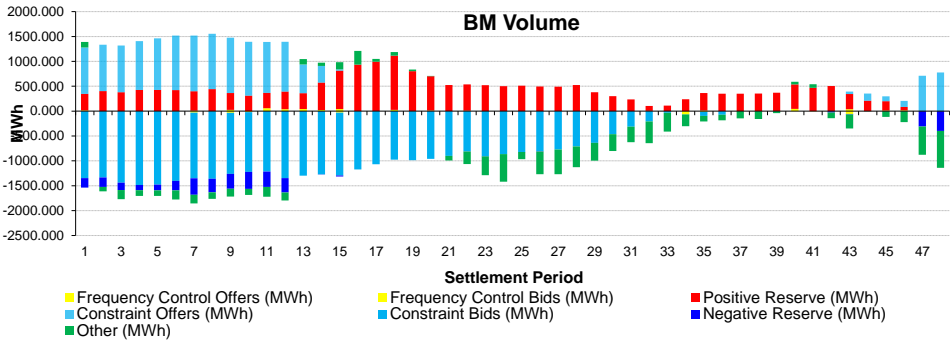
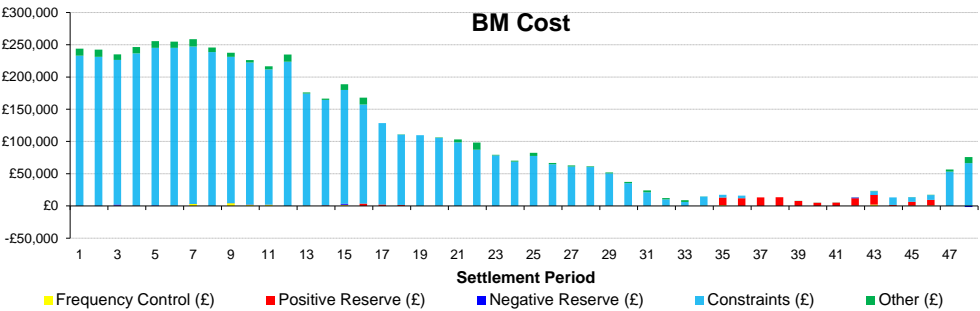


# Daily Balancing Costs

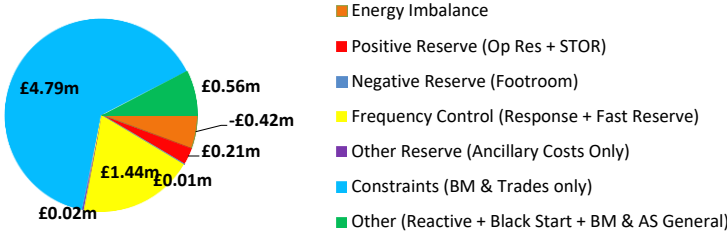

BM Cost (Indicative)

AS Cost (Estimate)



**Commentary**

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation and Margin.

Trades and BM Actions helped to manage thermal constraints in Scotland and Wales throughout the day. Trades and BM Actions supported Voltage Control.