

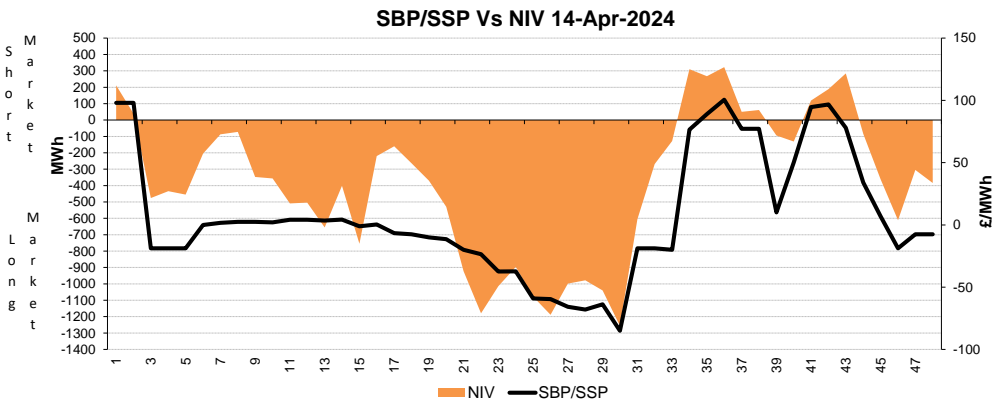
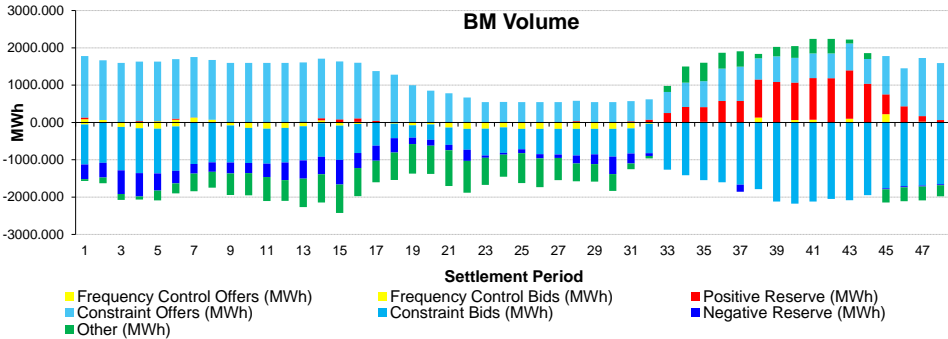
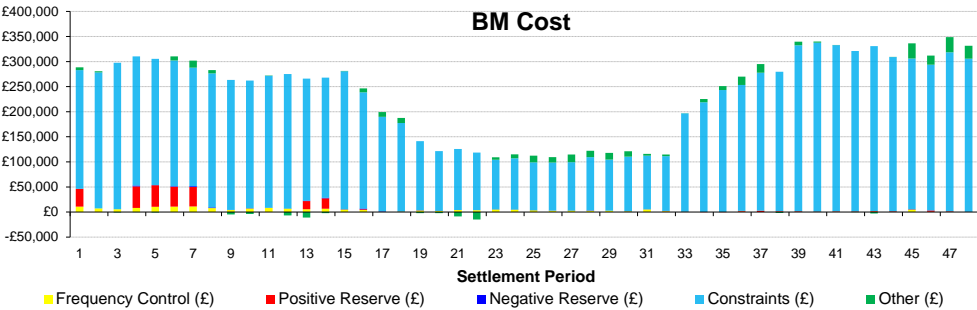


Daily Balancing Costs

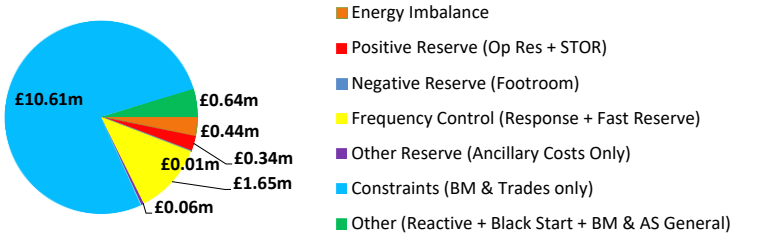

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was long throughout the day except for some short periods between 00:00-01:00, 16:30-19:00, and 20:00-21:30. Trades were required for Margin and Downward Regulation. Trades and BM Actions helped manage thermal constraints in Scotland and North England throughout the day. Trades and BM Actions supported Voltage Control.