

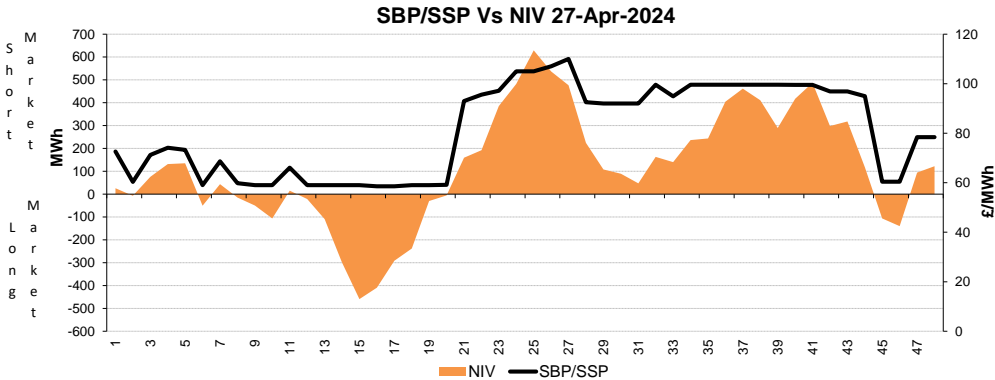
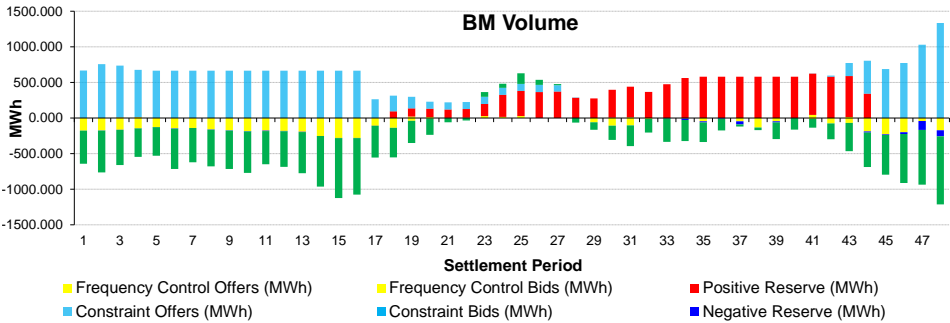
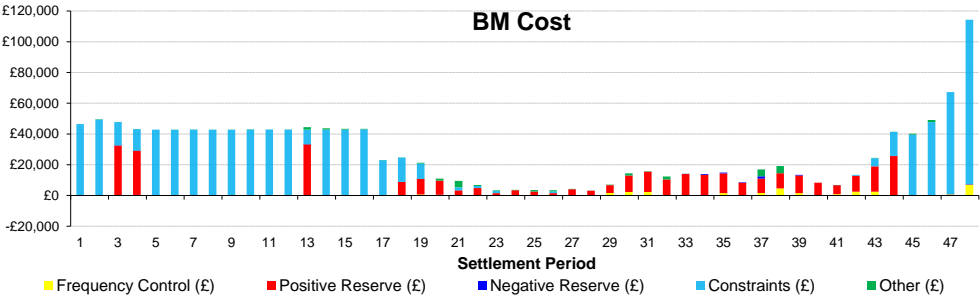


Daily Balancing Costs

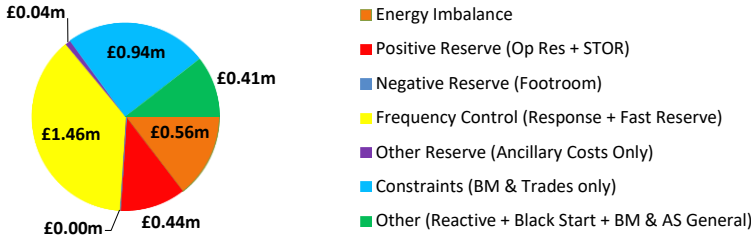

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was alternating between long and short throughout the day and predominantly short between 08:00-22:00. Trades were required for Margin and Downward Regulation. No BM Actions were required to manage thermal constraints throughout the day. Trades and BM Actions supported Voltage Control.