

Date:

Friday 26 Apr 2024

BSUoS Final Tariff: £7.63/MWh



Total Outturn: £2.13m

# Daily Balancing Costs






BM Cost (Indicative)

AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

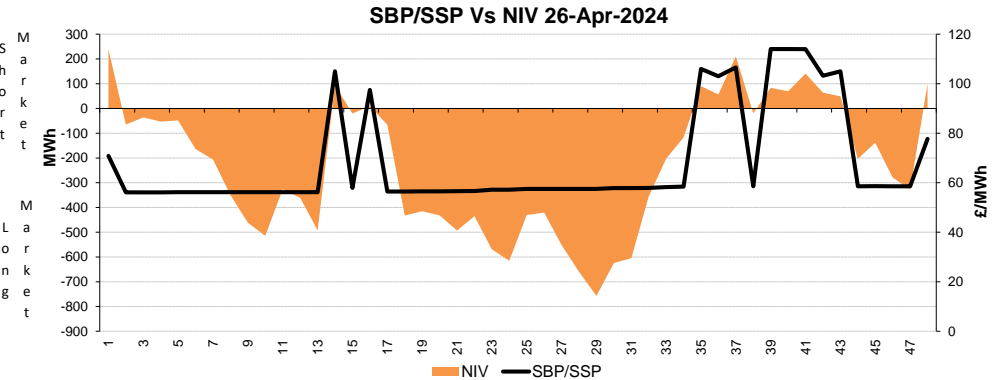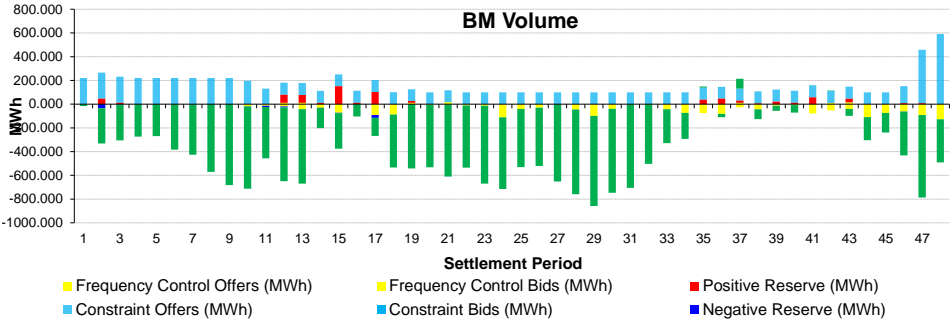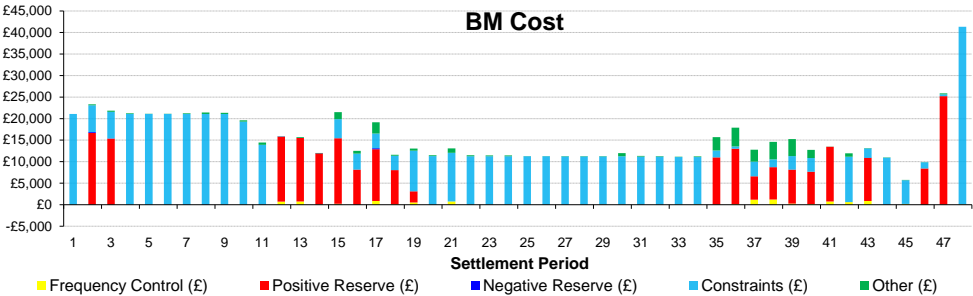

## Commentary

The market was long throughout the day except for some short periods between 00:30-01:00, 06:30-07:00, 07:30-08:00, 16:30-18:00, 19:00-21:00 and 23:30-00:00. No BM Actions were required to manage thermal constraints throughout the day. Trades and BM Actions supported Voltage Control.