

Date:

Wednesday 29 May 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £4.75m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

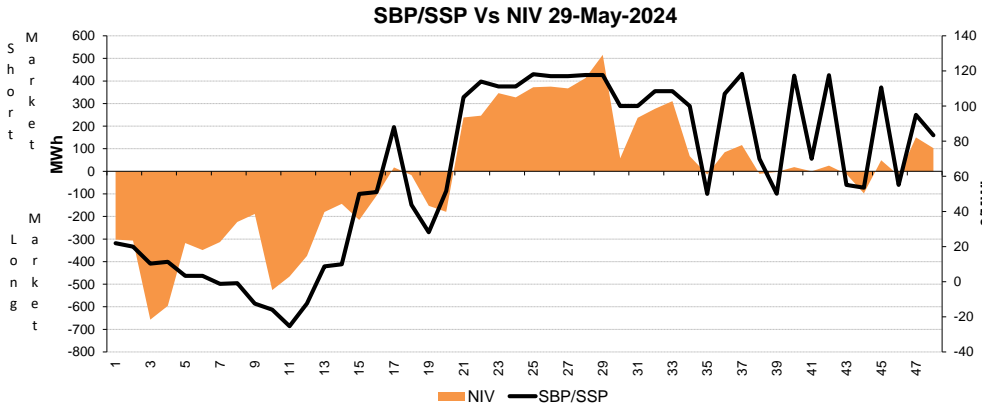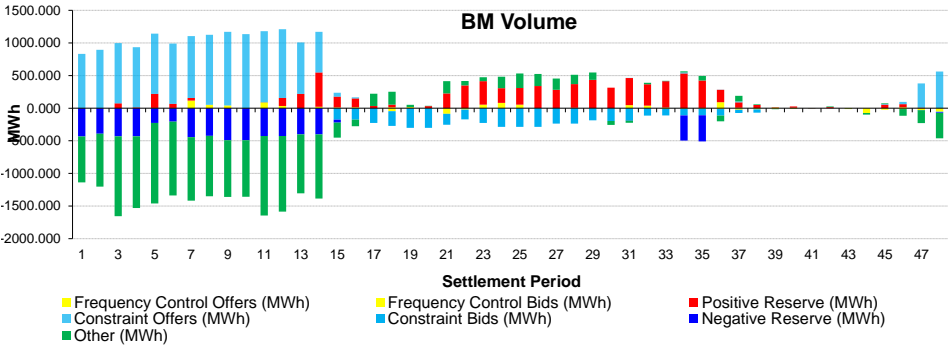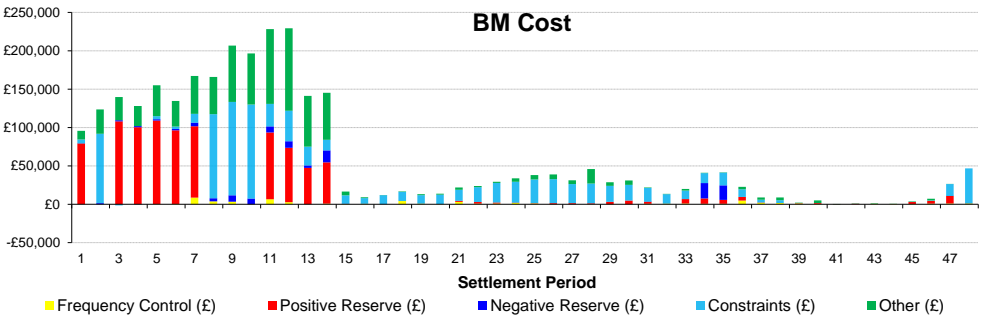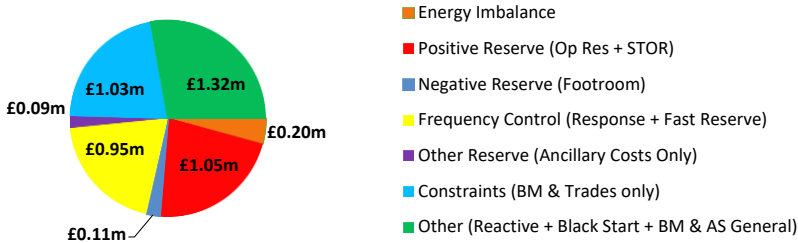

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions helped to manage thermal constraints in South of Scotland until evening and in Scotland during the night. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.