

Date:

Tuesday 14 May 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £7.14m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

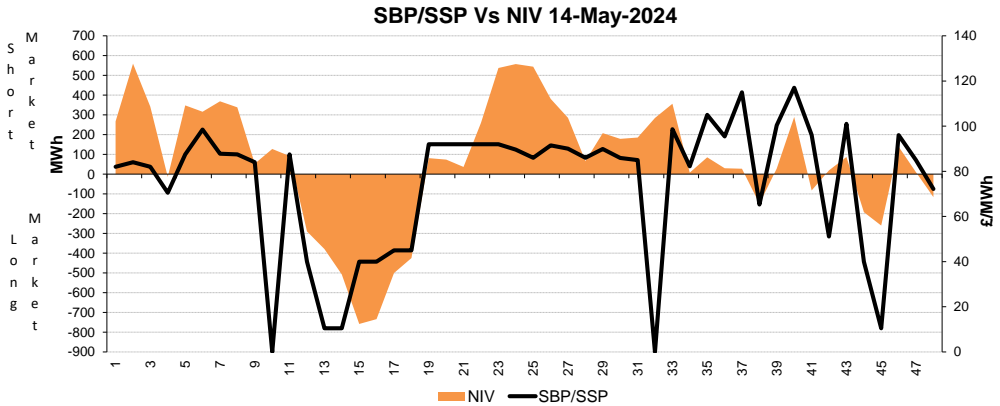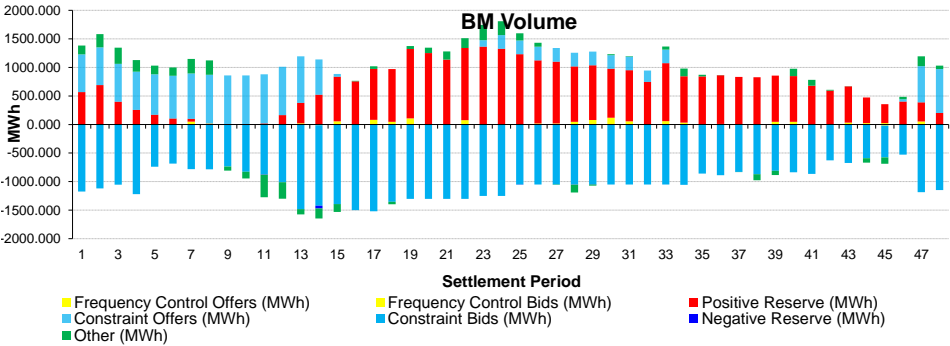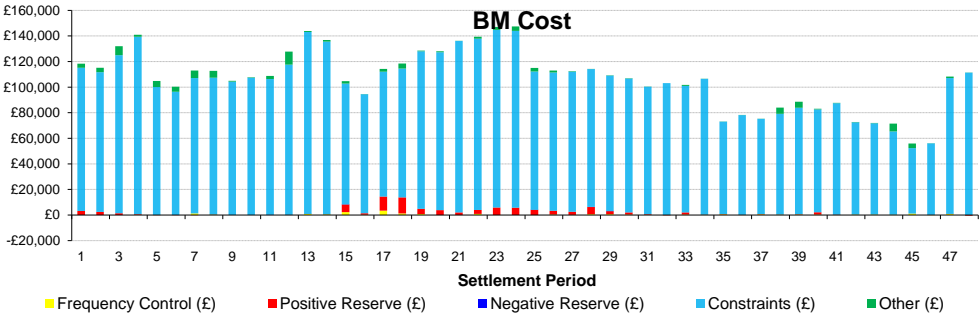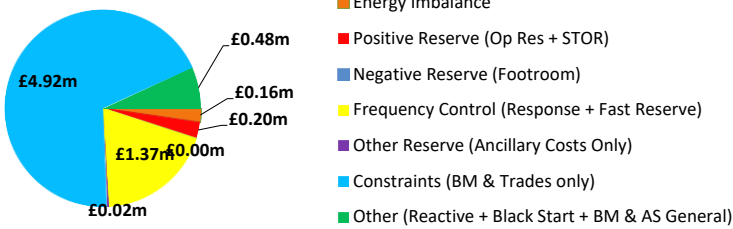

Commentary

The market was alternating between long and short throughout the day. No trades were required for either Margin or Downward Regulation. BM Actions and trades were required to manage thermal constraints in both England and Scotland. Trades and BM Actions supported Voltage Control. BM Actions also supported System Inertia.