

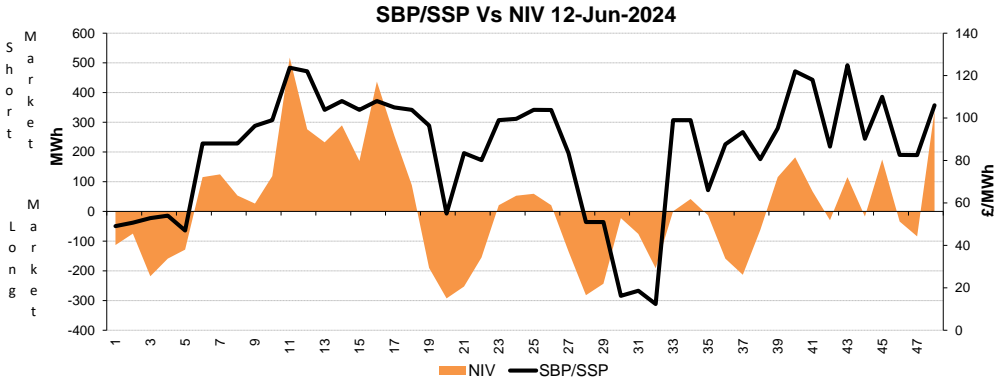
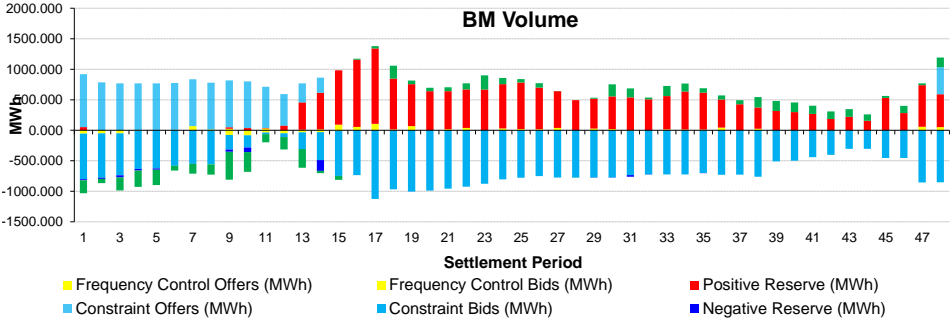
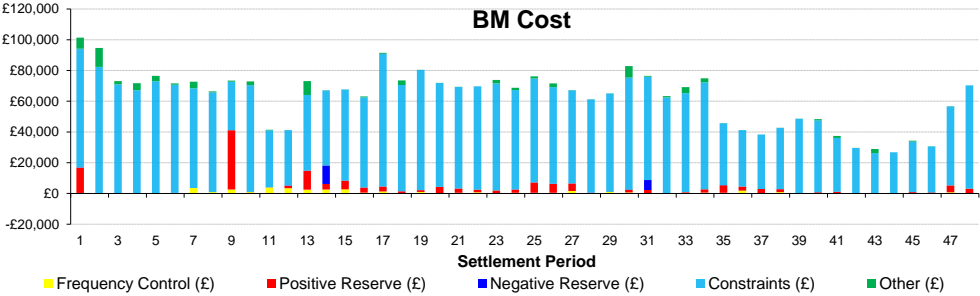


# Daily Balancing Costs

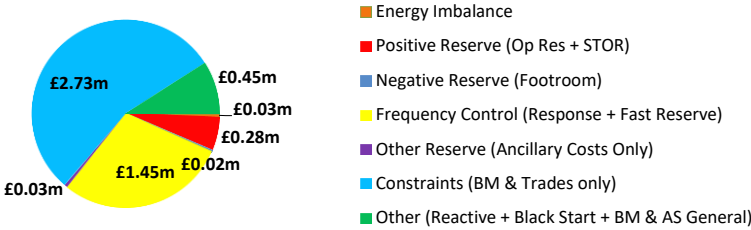

BM Cost (Indicative)

AS Cost (Estimate)



**Commentary**

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation.

Trades and BM Actions were required to manage thermal constraints in Scotland and South England throughout the day. Trades and BM Actions supported Voltage Control.