

Date:

Saturday 15 Jun 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £8.56m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

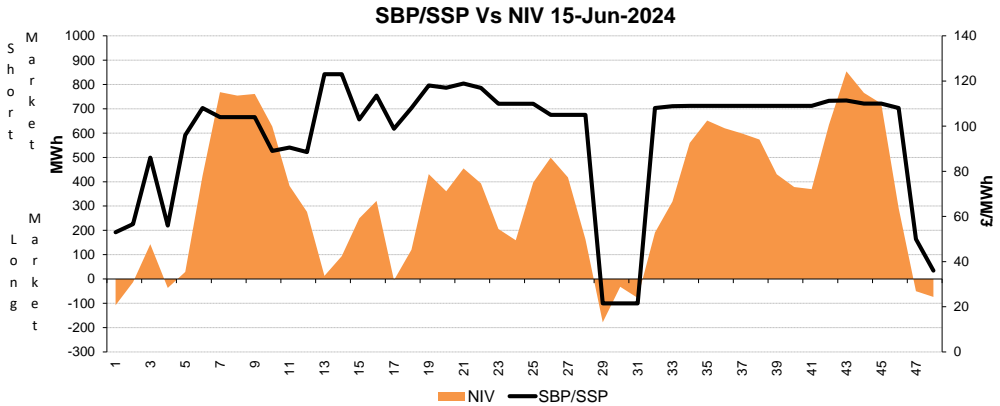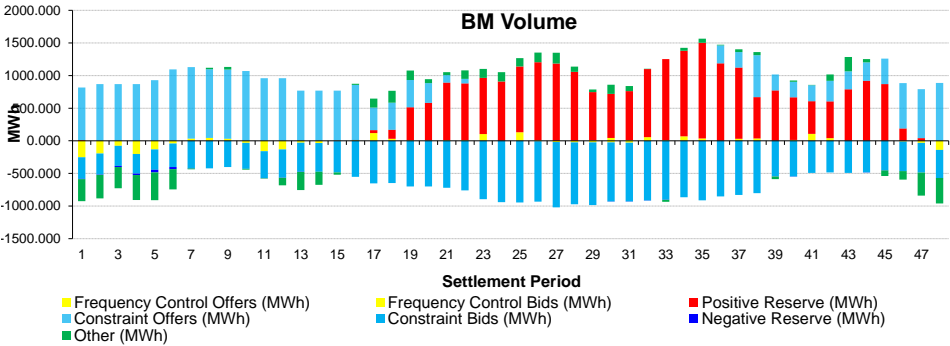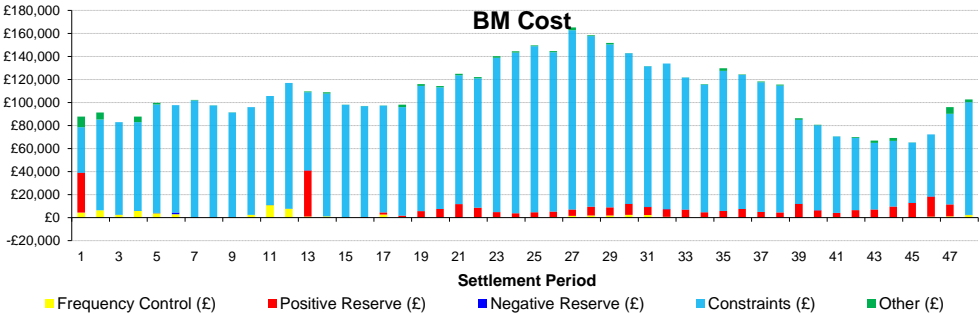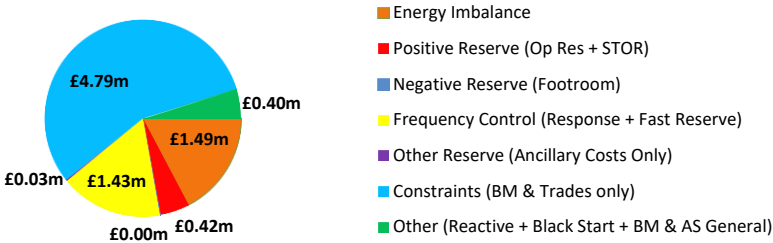

Commentary

The market was predominantly long between 2:30am and 11pm, with the only short periods being from 8-8:30am and 2pm-3:30pm during this time. There were no trades for Downward Regulation or Margin. Trades and BM Actions helped to manage thermal constraints in Southeast England throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions were taken to support System Inertia.