

Date:

Friday 21 Jun 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £4.55m

Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)

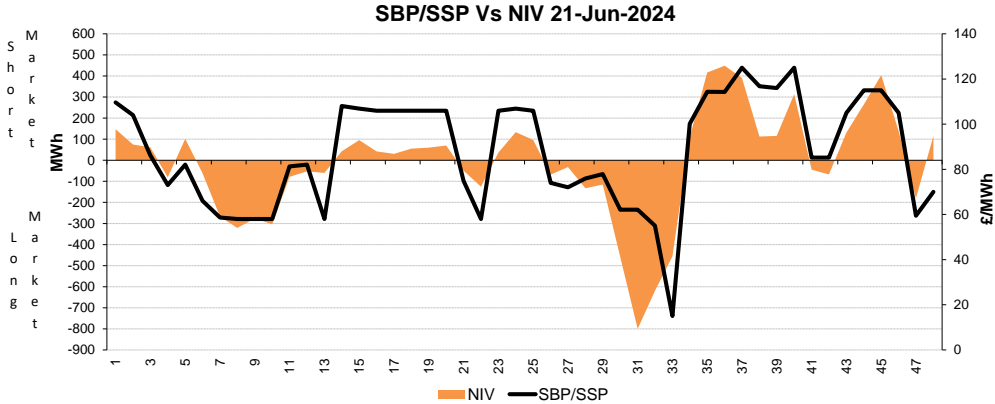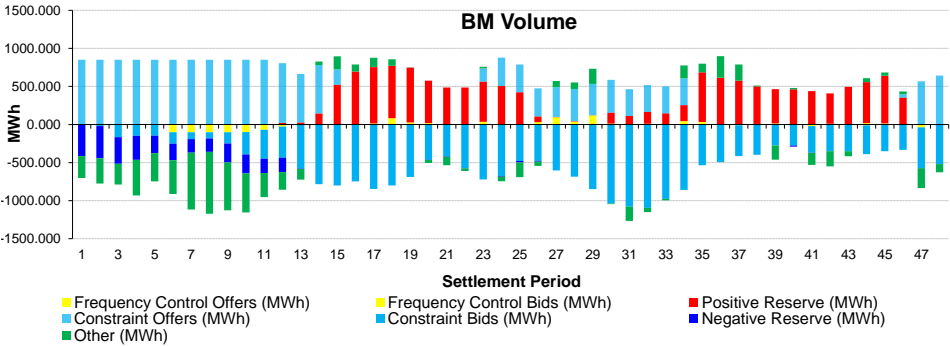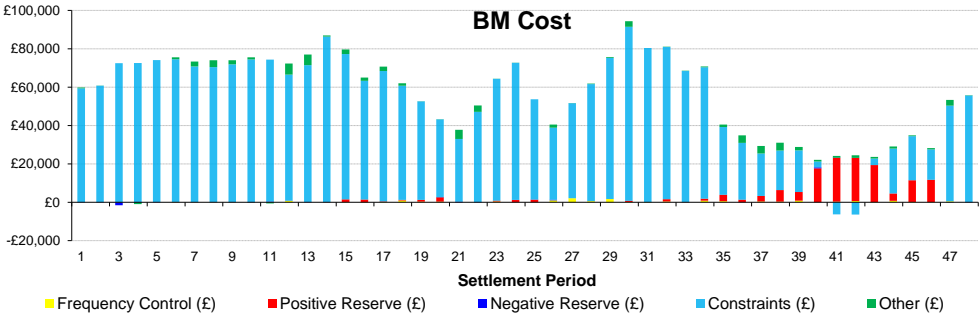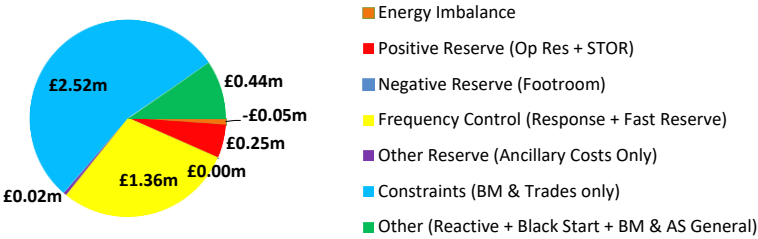

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. Trades and BM Actions were required to manage thermal constraints in England and Scotland throughout the day. Trades and BM Actions also supported Voltage Control. Further BM Actions were taken to support System Inertia.