

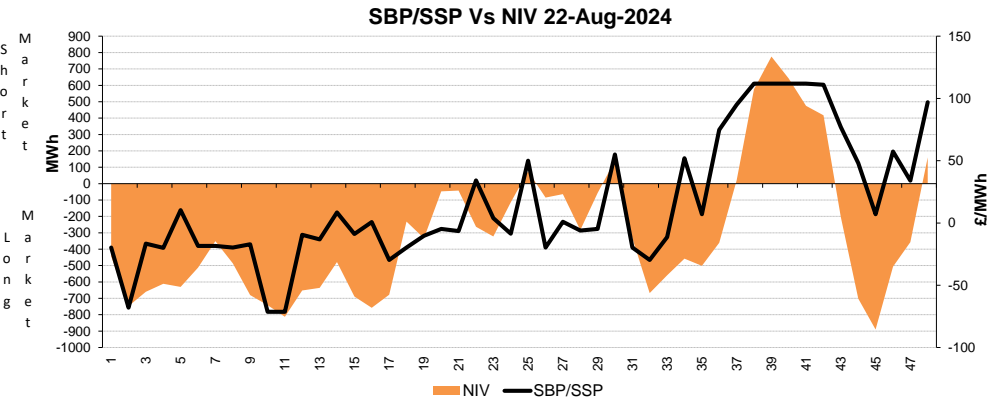
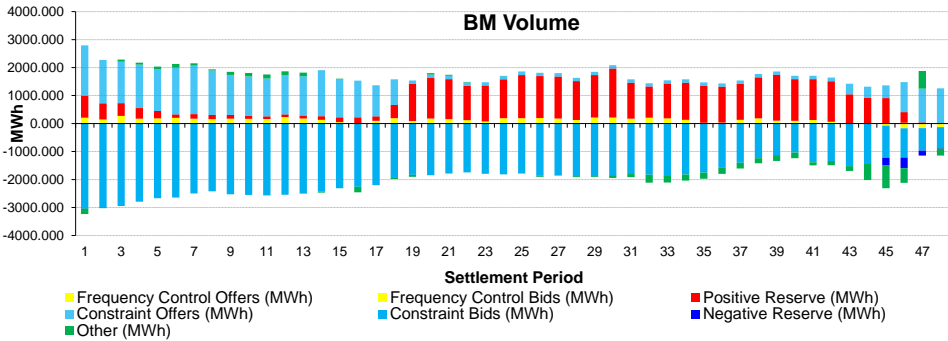
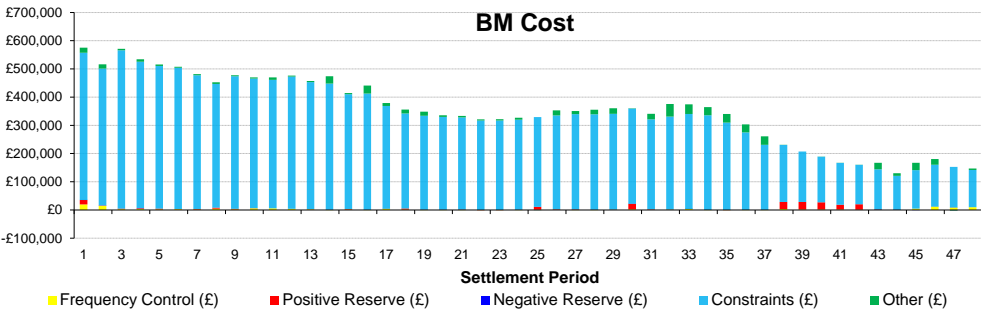


Daily Balancing Costs

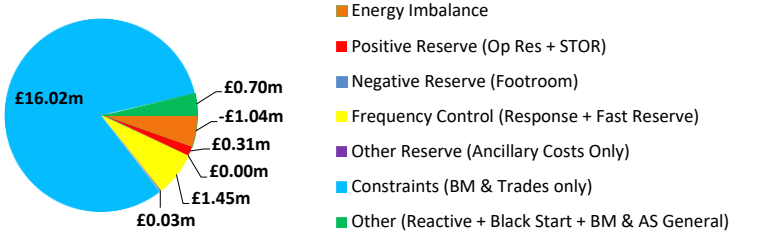

BM Cost (Indicative)

AS Cost (Estimate)



Commentary

The market was predominantly long throughout the day except for some short periods between 12:00-12:30, 14:30-15:00, 18:00-21:30 & 23:30-00:00. Trades were required for Downward Regulation. Trades and BM Actions were required to manage thermal constraints across England, Scotland and Wales throughout the day. Trades and BM Actions supported Voltage Control. Further BM Actions helped to manage System Inertia.