

Date:

Monday 26 Aug 2024






BSUoS Final Tariff: £7.63/MWh

Total Outturn: £8.63m

# Daily Balancing Costs



BM Cost (Indicative)  
AS Cost (Estimate)

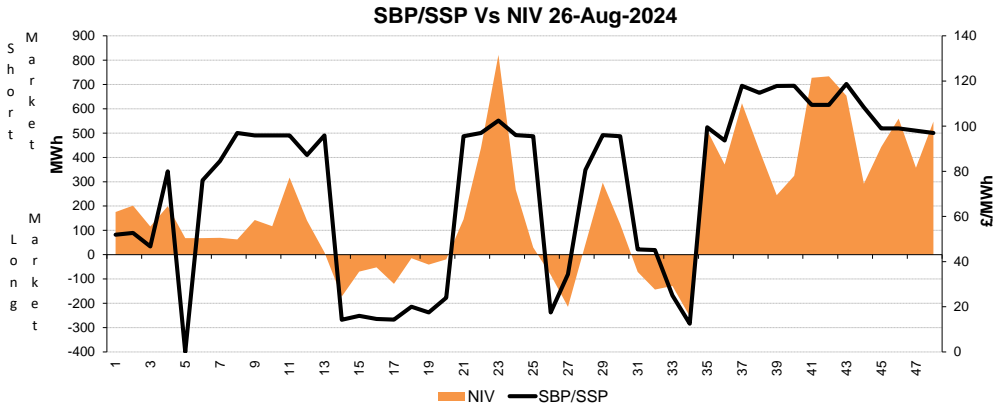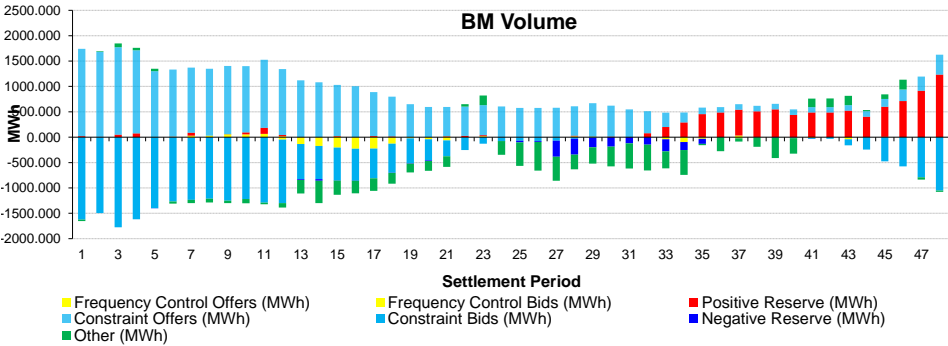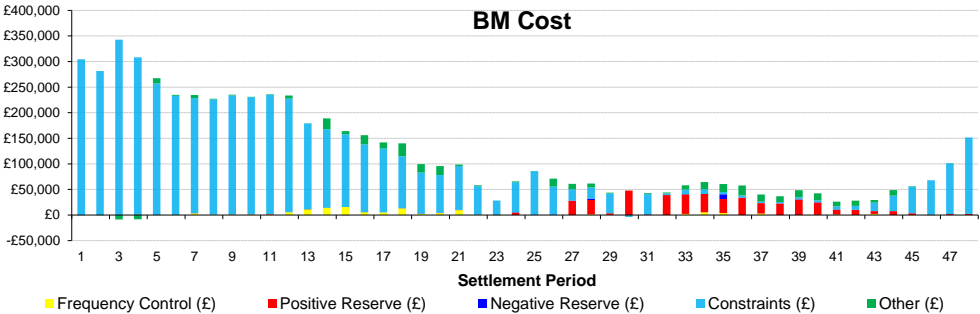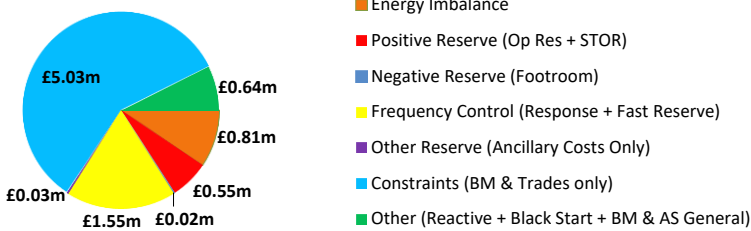

## Commentary

The market was alternating between long and short throughout the day. Trades were required for Margin and Downward Regulation. Trades and BM Actions were required to manage thermal constraints in England, Scotland and Wales during the first half of the day as well as at the end of the day. Trades and BM Actions supported Voltage Control. Further BM Actions helped to manage System Inertia.