

Date:

Monday 27 Jan 2025

BSUoS Final Tariff: £12.17/MWh

Total Outturn: £3.75m

Daily Balancing Costs








BM Cost (Indicative)

AS Cost (Estimate)

£2.08m

£1.68m

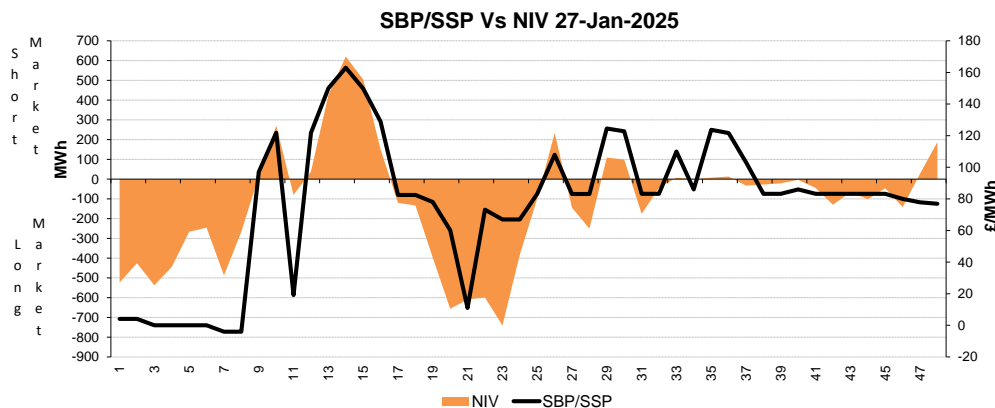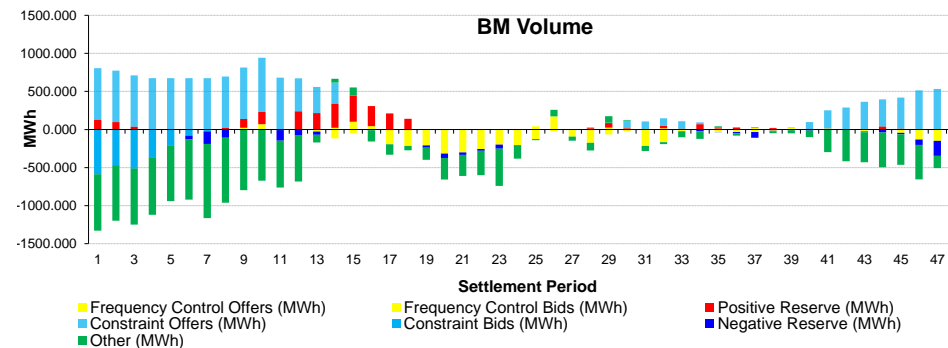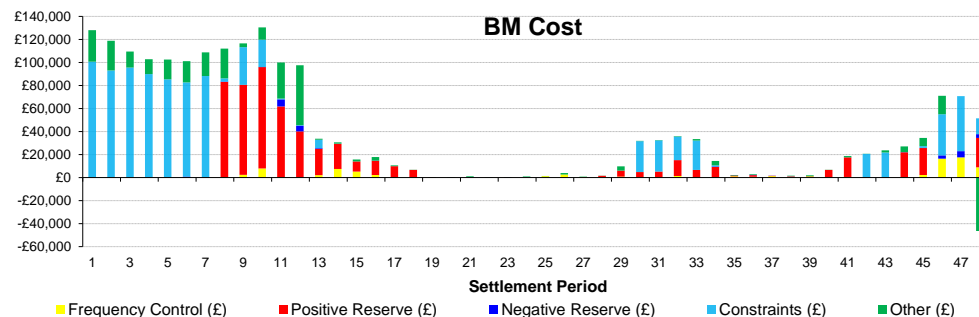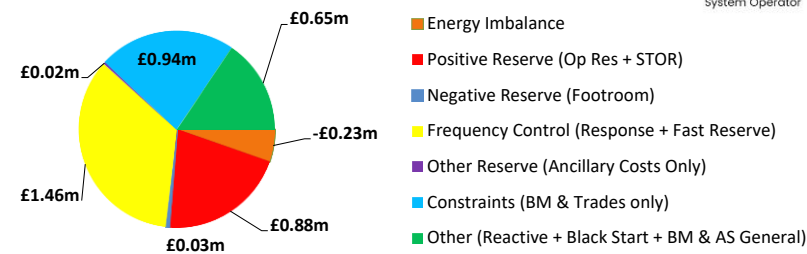

Commentary

The market was alternating between long and short throughout the day. Trades were required for Downward Regulation. BM Actions helped to manage thermal constraints in Scotland during the early morning and evening, and in England during the afternoon. Trades and BM Actions supported Voltage Control and further BM Actions supported System Inertia.